

# ELECTRICAL INSTALLATION CONDITION REPORT

Requirements For Electrical Installations - BS 7671 IET Wiring Regulations

Report Reference: 10938379



## 1 DETAILS OF THE PERSON ORDERING THE REPORT

Client: Holybourne theatre  
Address: London Road, Holybourne, Alton

## 2 REASON FOR PRODUCING THIS REPORT

Reason for producing this report:  
5 yearly Safety assessment requested by client.

Date(s) on which inspection and testing was carried out: 14/07/2022

## 3 DETAILS OF THE INSTALLATION WHICH IS THE SUBJECT OF THIS REPORT

Installation Address: Holybourne theatre, London Road, Holybourne, Alton

Description of premises: Domestic  N/A Commercial  Industrial  Other:  N/A  
Estimated age of wiring system: 25 years Evidence of additions/alterations: Yes if yes, estimated age: 5 years  
Installation records available? (Regulation 651.1) No Date of last inspection: 07/03/2017

## 4 EXTENT AND LIMITATIONS OF INSPECTION AND TESTING

Extent of the electrical installation covered by this report:  
50% of the installation in accordance with item 3.8.4 of Guidance Note 3.  
100% of the sub main Distribution installation.

Agreed limitations including the reasons (see Regulation 653.2):

No Lifting of floor boards or inspection of loft space.

Agreed with: Site Manager

Operational limitations including the reasons:

None

The inspection and testing detailed in this report and accompanying schedules have been carried out in accordance with BS 7671:2018 (IET Wiring Regulations) as amended to 2018. It should be noted that cables concealed within trunking and conduits, under floors, in roof spaces, and generally within the fabric of the building or underground, have not been inspected unless specifically agreed between the client and inspector prior to the inspection. An inspection should be made within an accessible roof space housing other electrical equipment.

## 5 SUMMARY OF THE CONDITION OF THE INSTALLATION

See page 3 for a summary of the general condition of the installation in terms of electrical safety.

Overall assessment of the installation in terms of it's suitability for continued use\*:

UNSATISFACTORY

\* An unsatisfactory assessment indicates that dangerous (Code C1) and/or potentially dangerous (Code C2) conditions have been identified.

## 6 RECOMMENDATIONS

Where the overall assessment of the suitability of the installation for continued use on page 1 is stated as 'UNSATISFACTORY', I/We recommend that any observations classified as 'Code 1 - Danger Present' or 'Code 2 - Potentially dangerous' are acted upon as a matter of urgency.

Investigation without delay is recommended for observations identified as 'FI - Further Investigation Required'.

Observations classified as 'Code 3 - Improvement recommended' should be given due consideration.

Subject to the necessary remedial action being taken, I/we recommend that the installation is further inspected and tested by:

5 Years

Note: The proposed date for the next inspection should take into consideration the frequency and quality of maintenance that the installation can reasonably be expected to receive during its intended life. The period should be agreed between relevant parties.

## 7 OBSERVATIONS AND RECOMMENDATIONS FOR ACTIONS TO BE TAKEN

Referring to the attached schedules of inspection and test results, and subject to the limitations specified on page 1 of this report under 'Extent of the Installation and Limitations of Inspection and Testing':

N/A There are no items adversely affecting electrical safety

or

The following observations and recommendations are made

Item No	Observations	Classification Code
1	Inspection Schedule Item 5.15: Presence of RCD six-monthly test notice at or near equipment, where required (514.12.2) is recommended for improvement.	C3
2	Inspection Schedule Item 5.16: Presence of diagrams, charts or schedules at or near equipment, where required (514.9.1) is recommended for improvement.	C3
3	Inspection Schedule Item 5.17: Presence of non-standard (mixed) cable colour warning notice at or near equipment, where required (514.14) is recommended for improvement.	C3
4	Inspection Schedule Item 5.24: Protection against electromagnetic effects where cables enter ferromagnetic enclosures (521.5.1) is recommended for improvement.	C3
5	Inspection Schedule Item 3.1.3: Adequacy of earthing conductor connections (542.3.2) is in a dangerous condition and presents risk of injury. Immediate remedial action is required.	C1
6	Inspection Schedule Item 3.1.6: Adequacy and location of main protective bonding conductor connections (543.3.2; 544.1.2) is recommended for improvement.	C3
7	Inspection Schedule Item 3.1.7: Accessibility of all protective bonding connections (543.3.2) is in a dangerous condition and presents risk of injury. Immediate remedial action is required.	C1
8	Inspection Schedule Item 3.1.8: Provision of earthing/bonding labels at all appropriate locations (514.13) is recommended for improvement.	C3
9	Inspection Schedule Item 4.3: Electrical separation (Section 413; 418.3) is recommended for improvement.	C3
10	Inspection Schedule Item 6.1: Identification of conductors (514.3.1) is recommended for improvement.	C3
15	Inspection Schedule Item 6.8: Examination of cables for signs of unacceptable thermal or mechanical damage/deterioration (421.1; 522.6) is in a potentially dangerous condition. Urgent remedial action is required.	C2
16	Inspection Schedule Item 1.2: Service head is in a potentially dangerous condition. Urgent remedial action is required.	C2

One of the following codes, as appropriate, has been allocated to each of the observations made above to indicate to the person(s) responsible for the installation the degree of urgency for remedial action.

**C1** Danger Present  
Risk of injury. Immediate remedial action required

**C2** Potentially dangerous  
Urgent remedial action required

**C3** Improvement recommended

**F1** Further investigation required without delay

Immediate remedial action required for items:

5, 7

Urgent remedial action required for items:

15, 16

Improvement recommended for items:

1, 2, 3, 4, 6, 8, 9, 10

Further investigation required for items:

N/A

**7 OBSERVATIONS AND RECOMMENDATIONS FOR ACTIONS TO BE TAKEN (CONTINUED)**

Item No	Observations	Classification Code
17	Inspection Schedule Item 7.1: Identification of conductors (514.3.1) is in a potentially dangerous condition. Urgent remedial action is required.	C2
17	Inspection Schedule Item 7.2: Cables correctly supported throughout their run (521.10.202; 522.8.5) is in a potentially dangerous condition. Urgent remedial action is required.	C2
17	Inspection Schedule Item 7.3: Condition of insulation of live parts (416.1) is in a dangerous condition and presents risk of injury. Immediate remedial action is required.	C1
17	Inspection Schedule Item 7.5: Suitability of containment systems for continued use (including flexible conduit) (Section 522) is in a potentially dangerous condition. Urgent remedial action is required.	C2
18	Inspection Schedule Item 7.6: Adequacy of cables for current-carrying capacity with regard for the type and nature of installation (Section 523) is in a dangerous condition and presents risk of injury. Immediate remedial action is required.	C1
18	Inspection Schedule Item 7.8: Presence and adequacy of circuit protective conductors (411.3.1.1; 543.1) is in a potentially dangerous condition. Urgent remedial action is required.	C2
19	Inspection Schedule Item 7.14: Band II cables segregated/separated from Band I cables (528.1) is recommended for improvement.	C3
20	Inspection Schedule Item 8.1.3: Capable of being secured in the OFF position (462.3) is recommended for improvement.	C3
21	Inspection Schedule Item 1.3: Earthing arrangements is in a dangerous condition and presents risk of injury. Immediate remedial action is required.	C1

One of the following codes, as appropriate, has been allocated to each of the observations made above to indicate to the person(s) responsible for the installation the degree of urgency for remedial action:

**C1** Danger Present  
Risk of injury. Immediate remedial action required

**C2** Potentially dangerous  
Urgent remedial action required

**C3** Improvement recommended

**F1** Further investigation required without delay

Immediate remedial action required for items:

Urgent remedial action required for items:

Improvement recommended for items:

Further investigation required for items:

D.B. 2 - CORRIDOR  
OBSERVATIONS AND RECOMMENDATIONS

**OBSERVATIONS AND RECOMMENDATIONS FOR ACTIONS TO BE TAKEN**

Item No	Observations	Classification Code
1	Circuit 5L1 Zs exceeds maximum value, cable too small requires rewiring with 4mm T&E	C1
2	N/A	N/A

One of the following codes, as appropriate, has been allocated to each of the observations made above to indicate to the person(s) responsible for the installation the degree of urgency for remedial action:

- C1** Danger Present  
Risk of injury. Immediate remedial action required
- C2** Potentially dangerous  
Urgent remedial action required
- C3** Improvement recommended
- F1** Further investigation required without delay

Immediate remedial action required for items:

Urgent remedial action required for items:

Improvement recommended for items:

Further investigation required for items:

## 8 GENERAL CONDITION OF THE INSTALLATION

General condition of the installation (in terms of electrical safety):

This installation has been modified since the last inspection, there are several items of remedial work that require attention.

## 9 DECLARATION

I/We, being the person(s) responsible for the inspection and testing of the electrical installation (as indicated by my/our signatures below), particulars of which are described above, having exercised reasonable skill and care when carrying out the inspection and testing, hereby declare that the information in this report, including the observations and the attached schedules, provides an accurate assessment of the condition of the electrical installation taking into account the stated extent and limitations in section 4 of this report.

Trading Title: **CMC ELECTRICAL ENGINEERING LTD**

Address: **4 Bighton Road Bungalows  
Bighton Road  
Medstead**

Registration Number (if applicable): **59744**

Telephone Number: **01420562013**

Postcode: **GU34 5ND**

For the INSPECTION, TESTING AND ASSESSMENT of the report:

Name: **Carl Mchenry** Position: **Qualified Supervisor** Signature: \_\_\_\_\_ Date: **14/07/2022**

## 10 SUPPLY CHARACTERISTICS AND EARTHING ARRANGEMENTS

Earthing Arrangements	Number and Type of Live Conductors				Nature of Supply Parameters			Supply Protective Device	
TN-S	N/A	ac: <input checked="" type="checkbox"/>	dc: <input type="checkbox"/>	N/A	Nominal voltage(s):	U: <b>400 V</b>	Uo: <b>230 V</b>	BS(EN):	<b>1361 Fuse HBC</b>
TN-C-S	<input checked="" type="checkbox"/>	1-phase (2 wire): <b>N/A</b>	1-phase (3 wire): <b>N/A</b>	2 pole: <b>N/A</b>		Nominal frequency, f:	<b>50 Hz</b>	Type:	<b>2</b>
TNC	N/A	3-phase (3 wire): <input checked="" type="checkbox"/>	3-phase (4 wire): <b>N/A</b>	3 pole: <b>N/A</b>	Prospective fault current, Ipf:	<b>0.53 kA</b>	Rated current:	<b>100 A</b>	
TT	N/A	Other: <b>N/A</b>	Other: <b>N/A</b>	Other: <b>N/A</b>	External earth fault loop impedance, Ze:	<b>0.43 Ω</b>	Short-circuit capacity:	<b>33 kA</b>	
IT	N/A	Confirmation of supply polarity: <input checked="" type="checkbox"/>			Number of supplies:	<b>1</b>			

## 11 PARTICULARS OF INSTALLATION REFERRED TO IN THE CERTIFICATE

Means of Earthing		Details of Installation Earth Electrode (where applicable)			
Distributor's facility:	<input checked="" type="checkbox"/>	Type:	<b>N/A</b>	Location:	<b>N/A</b>
Installation earth electrode:	<b>N/A</b>	Resistance to Earth:	<b>N/A Ω</b>	Method of measurement:	<b>N/A</b>
Maximum Demand (Load):	<b>100 Amps</b>	Protective measure(s) against electric shock:			<b>ADS</b>
Main Switch / Switch-Fuse / Circuit-Breaker / RCD Type		Current rating:		Supply conductors material:	If RCD main switch:
BS(EN):	<b>5419 Isolator</b>	<b>100 A</b>		<b>Copper</b>	Rated residual operating current (IΔn):
Number of poles:	<b>N/A</b>	Fuse/device rating or setting:		<b>25 mm<sup>2</sup></b>	<b>N/A mA</b>
		Voltage rating:			Rated time delay:
		<b>230 V</b>			<b>N/A ms</b>
					Measured operating time (at IΔn):
					<b>N/A ms</b>
Earthing and Protective Bonding Conductors				Bonding of extraneous-conductive parts	
Earthing conductor	Connection/continuity verified:		To water installation pipes:		<input checked="" type="checkbox"/>
Conductor material:	<b>Copper</b>	csa: <b>16 mm<sup>2</sup></b>	<input checked="" type="checkbox"/>	To oil installation pipes:	<b>N/A</b>
Main protective bonding conductors	Connection/continuity verified:		To structural steel:		<input checked="" type="checkbox"/>
Conductor material:	<b>Copper</b>	csa: <b>10 mm<sup>2</sup></b>	<input checked="" type="checkbox"/>		<b>N/A</b>
					To lightning protection:
					To other service(s):
					<b>N/A</b>

## 12 INSPECTION SCHEDULE

Item	Description	Comment	Outcome
1.0	EXTERNAL CONDITION OF INTAKE EQUIPMENT (VISUAL INSPECTION ONLY)		
1.1	Service cable	N/A	✓
1.2	Service head	Signs of overheating - pitch leaking from head	C2
1.3	Earthing arrangements	external earth loop impedance exceeds recommended minimum for TNS connection	C1
1.4	Meter tails	N/A	✓
1.5	Metering equipment	N/A	✓
1.6	Isolator (where present)	N/A	✓
2.0	PRESENCE OF ADEQUATE ARRANGEMENTS FOR PARALLEL OR SWITCHED ALTERNATIVE SOURCES		
2.1	Adequate arrangements where a generating set operates as a switched alternative to the public supply (551.6)	N/A	N/A
2.2	Adequate arrangements where a generating set operates in parallel with the public supply (551.7)	N/A	N/A
3.0	AUTOMATIC DISCONNECTION OF SUPPLY		
3.1	Main earthing/bonding arrangements (411.3; Chap 54):		
3.1.1	Presence of distributor's earthing arrangement (542.1.2.1; 542.1.2.2), or presence of installation earth electrode arrangement (542.1.2.3)	N/A	N/A
3.1.2	Adequacy of earthing conductor size (542.3; 543.1.1)	N/A	✓
3.1.3	Adequacy of earthing conductor connections (542.3.2)	incorrect use of earth bonding clamp as PME connection - DNO to replace	C1
3.1.4	Accessibility of earthing conductor connections (543.3.2)	N/A	✓
3.1.5	Adequacy of main protective bonding conductor sizes (544.1)	N/A	✓
3.1.6	Adequacy and location of main protective bonding conductor connections (543.3.2; 544.1.2)	Missing clamp screw from earth block	C3
3.1.7	Accessibility of all protective bonding connections (543.3.2)	Main Bonding Conductor missing steel	C1
3.1.8	Provision of earthing/bonding labels at all appropriate locations (514.13)	Missing Labels	C3
3.2	FELV - requirements satisfied (411.7; 411.7.1)	N/A	✓
4.0	OTHER METHODS OF PROTECTION (where any of the methods listed below are employed details should be provided on separate sheets)		
4.1	Non-conducting location (418.1)	N/A	N/A
4.2	Earth-free local equipotential bonding (418.2)	N/A	N/A
4.3	Electrical separation (Section 413; 418.3)	Fire Alarm cabling to be separated from mains cable	C3
4.4	Double insulation (Section 412)	N/A	✓
4.5	Reinforced insulation (Section 412)	N/A	N/A
5.0	DISTRIBUTION EQUIPMENT		
5.1	Adequacy of working space/accessibility to equipment (132.12; 513.1)	N/A	✓
5.2	Security of fixing (134.1.1)	N/A	✓
5.3	Condition of insulation of live parts (416.1)	N/A	✓
5.4	Adequacy/security of barriers (416.2)	N/A	✓
5.5	Condition of enclosure(s) in terms of IP rating etc (416.2)	N/A	✓
5.6	Condition of enclosure(s) in terms of fire rating etc (421.1.6; 421.1.201; 526.5)	N/A	✓
5.7	Enclosure not damaged/deteriorated so as to impair safety (651.2)	N/A	✓
5.8	Presence and effectiveness of obstacles (417.2)	N/A	✓
5.9	Presence of main switch(es), linked where required (462.1; 462.1.201; 462.2)	N/A	N/A

OUTCOMES													
Acceptable condition	TICK	Unacceptable condition	C1 or C2	Improvement recommended	C3	Further investigation	FI	Not verified	N/V	Limitation	LIM	Not applicable	N/A

## 13 INSPECTION SCHEDULE (CONTINUED)

Item	Description	Comment	Outcome
5.10	Operation of main switch(es) (functional check) (643.10)	N/A	✓
5.11	Manual operation of circuit-breakers and RCDs to prove disconnection (643.10)	N/A	✓
5.12	Confirmation that integral test button/switch causes RCD(s) to trip when operated (functional check) (643.10)	N/A	✓
5.13	RCD(s) provided for fault protection – includes RCBOs (411.4.204; 411.5.2; 531.2)	N/A	✓
5.14	RCD(s) provided for additional protection/requirements, where required – includes RCBOs (411.3.3; 415.1)	N/A	✓
5.15	Presence of RCD six-monthly test notice at or near equipment, where required (514.12.2)	labeling required	C3
5.16	Presence of diagrams, charts or schedules at or near equipment, where required (514.9.1)	requires improvement	C3
5.17	Presence of non-standard (mixed) cable colour warning notice at or near equipment, where required (514.14)	labeling required	C3
5.18	Presence of alternative supply warning notice at or near equipment, where required (514.15)	N/A	✓
5.19	Presence of next inspection recommendation label (514.12.1)	N/A	✓
5.20	Presence of other required labelling (please specify) (Section 514)	N/A	✓
5.21	Compatibility of protective devices, bases and other components; correct type and rating (no signs of unacceptable thermal damage, arcing or overheating) (411.3.2; 411.4; 411.5; 411.6; Sections 432, 433)	N/A	✓
5.22	Single-pole switching or protective devices in line conductors only (132.14.1; 530.3.3)	N/A	✓
5.23	Protection against mechanical damage where cables enter equipment (522.8.1; 522.8.5; 522.8.11)	N/A	✓
5.24	Protection against electromagnetic effects where cables enter ferromagnetic enclosures (521.5.1)	Isolator A live and neutral conductors do	C2
6.0	<b>DISTRIBUTION CIRCUITS</b>		
6.1	Identification of conductors (514.3.1)	N/A	✓
6.2	Cables correctly supported throughout their run (521.10.202; 522.8.5)	N/A	✓
6.3	Condition of insulation of live parts (416.1)	N/A	✓
6.4	Non-sheathed cables protected by enclosure in conduit, ducting or trunking (521.10.1)	N/A	✓
6.5	Suitability of containment systems for continued use (including flexible conduit) (Section 522)	N/A	✓
6.6	Cables correctly terminated in enclosures (Section 526)	N/A	✓
6.7	Confirmation that ALL conductor connections, including connections to busbars, are correctly located in terminals and are tight and secure (526.1)	N/A	✓
6.8	Examination of cables for signs of unacceptable thermal or mechanical damage/deterioration (421.1; 522.6)	Isolator A signs of thermal damage	C2
6.9	Adequacy of cables for current-carrying capacity with regard for the type and nature of installation (Section 523)	N/A	✓
6.10	Adequacy of protective devices: type and rated current for fault protection (411.3)	N/A	✓
6.11	Presence and adequacy of circuit protective conductors (411.3.1.1; 543.1)	N/A	✓
6.12	Coordination between conductors and overload protective devices (433.1; 533.2.1)	N/A	✓

### OUTCOMES

Acceptable condition	TICK	Unacceptable condition	C1 or C2	Improvement recommended	C3	Further investigation	FI	Not verified	N/V	Limitation	LIM	Not applicable	N/A
----------------------	------	------------------------	----------	-------------------------	----	-----------------------	----	--------------	-----	------------	-----	----------------	-----

## 14 INSPECTION SCHEDULE (CONTINUED)

Item	Description	Comment	Outcome
6.13	Cable installation methods/practices with regard to the type and nature of installation and external influences (Section 522)	N/A	✓
6.14	Where exposed to direct sunlight, cable of a suitable type (522.11.1)	N/A	✓
6.15	Cables concealed under floors, above ceilings, in walls/partitions less than 50mm from a surface, and in partitions containing metal parts:		
6.15.1	Installed in prescribed zones (see Section 4. Extent and limitations) (522.6.202) or	N/A	N/V
6.15.2	Incorporating earthed armour or sheath, or run within earthed wiring system, or otherwise protected against mechanical damage by nails, screws and the like (see Section 4. Extent and limitations) (522.6.204)	N/A	N/V
6.16	Provision of fire barriers, sealing arrangements and protection against thermal effects (Section 527)	N/A	N/V
6.17	Band II cables segregated/separated from Band I cables (528.1)	N/A	N/V
6.18	Cables segregated/separated from non-electrical services (528.3)	N/A	N/V
6.19	Condition of circuit accessories (651.2)	N/A	N/V
6.20	Suitability of circuit accessories for external influences (512.2)	N/A	N/V
6.21	Single-pole switching or protective devices in line conductors only (132.14.1; 530.3.3)	N/A	N/V
6.22	Adequacy of connections, including cpcs, within accessories and to fixed and stationary equipment – identify/record numbers and locations of items inspected (Section 526)	N/A	N/V
6.23	Presence, operation and correct location of appropriate devices for isolation and switching (Chapter 46; Section 537)	N/A	N/V
6.24	General condition of wiring systems (651.2)	N/A	N/V
6.25	Temperature rating of cable insulation (522.1.1; Table 52.1)	N/A	N/V
7.0	<b>FINAL CIRCUITS</b>		
7.1	Identification of conductors (514.3.1)	switch lines at lighting switches not correctly identified	C2
7.2	Cables correctly supported throughout their run (521.10.202; 522.8.5)	Cables poorly installed additional support required	C2
7.3	Condition of insulation of live parts (416.1)	lighting tower floating terminal 230v	C1
7.4	Non-sheathed cables protected by enclosure in conduit, ducting or trunking (521.10.1)	N/A	✓
7.5	Suitability of containment systems for continued use (including flexible conduit) (Section 522)	Basket tray missing earth bonds	C2
7.6	Adequacy of cables for current-carrying capacity with regard for the type and nature of installation (Section 523)	Disabled WC Heater Circuit DB2 5L! High Value of Zs rewire required	C1
7.7	Adequacy of protective devices: type and rated current for fault protection (411.3)	N/A	✓
7.8	Presence and adequacy of circuit protective conductors (411.3.1.1; 543.1)	W.C heaters, reception light switch no bonding cable to back box	C2
7.9	Co-ordination between conductors and overload protective devices (433.1; 533.2.1)	N/A	✓
7.10	Wiring system(s) appropriate for the type and nature of the installation and external influences (Section 522)	N/A	✓
7.11	Cables concealed under floors, above ceilings, in walls/partitions, adequately protected against damage (522.6.201; 522.6.202; 522.6.203; 522.6.204):		
7.11.1	Installed in prescribed zones (see Section 4. Extent and limitations) (522.6.202)	N/A	✓
7.11.2	Incorporating earthed armour or sheath, or run within earthed wiring system, or otherwise protected against mechanical damage by nails, screws and the like (see Section 4. Extent and limitations) (522.6.201; 522.6.204)	N/A	✓

OUTCOMES													
Acceptable condition	TICK	Unacceptable condition	C1 or C2	Improvement recommended	C3	Further investigation	FI	Not verified	N/V	Limitation	LIM	Not applicable	N/A



**15 INSPECTION SCHEDULE (CONTINUED)**

Item	Description	Comment	Outcome
7.12	Provision of additional protection by 30mA RCD:		
7.12.1	For all socket-outlets of rating 32A or less unless exempt (411.3.3) *	N/A	✓
7.12.2	For the supply of mobile equipment not exceeding 32A rating for use outdoors (411.3.3) *	N/A	✓
7.12.3	For cables concealed in walls at a depth of less than 50mm (522.6.202, 522.6.203) *	N/A	✓
7.12.4	For cables concealed in walls/partitions containing metal parts regardless of depth (522.6.203) *	N/A	✓
7.12.5	For final circuits supplying luminaires within domestic (household) premises (411.3.4) *	N/A	✓
* Note: Older installations designed prior to BS 7671:2018 may not have been provided with RCDs for additional protection.			
7.13	Provision of fire barriers, sealing arrangements and protection against thermal effects (Section 527)	N/A	N/A
7.14	Band II cables segregated/separated from Band I cables (528.1)	Segregation not to BS7671	C3
7.15	Cables segregated/separated from non-electrical services (528.3)	N/A	✓
7.16	Termination of cables at enclosures – identify/record numbers and locations of items inspected (Section 526):		
7.16.1	Connections under no undue strain (526.6)	N/A	✓
7.16.2	No basic insulation of a conductor visible outside enclosure (526.8)	Various terminal boxes exposed inner insulation, require re-terminating	✓
7.16.3	Connections of live conductors adequately enclosed (526.5)	N/A	✓
7.16.4	Adequately connected at point of entry to enclosure (glands, bushes etc.) (522.8.5)	N/A	✓
7.17	Condition of accessories including socket-outlets, switches and joint boxes (651.2)	inspected 10% - satisfactory sampling	✓
7.18	Suitability of accessories for external influences (512.2)	N/A	✓
7.19	Single-pole switching or protective devices in line conductors only (132.14.1, 530.3.3)	N/A	✓
8.0	<b>ISOLATION AND SWITCHING</b>		
8.1	Isolators (Sections 460; 537):		
8.1.1	Presence and condition of appropriate devices (Section 462; 537.2.7)	N/A	✓
8.1.2	Acceptable location – state if local or remote from equipment in question (Section 462; 537.2.7)	N/A	✓
8.1.3	Capable of being secured in the OFF position (462.3)	old style of Isolator for DBs cant be locked off but the fuses can be removed and locked away	C3
8.1.4	Correct operation verified (643.10)	N/A	✓
8.1.5	Clearly identified by position and/or durable marking (537.2.6)	N/A	✓
8.1.6	Warning label posted in situations where live parts cannot be isolated by the operation of a single device (514.11.1; 537.1.2)	N/A	✓
8.2	Switching off for mechanical maintenance (Section 464; 537.3.2):		
8.2.1	Presence and condition of appropriate devices (464.1; 537.3.2)	N/A	✓
8.2.2	Acceptable location – state if local or remote from equipment in question (537.3.2.4)	N/A	✓
8.2.3	Capable of being secured in the OFF position (462.3)	N/A	✓
8.2.4	Correct operation verified (643.10)	N/A	✓
8.2.5	Clearly identified by position and/or durable marking (537.3.2.4)	N/A	✓

**OUTCOMES**

Acceptable condition	TICK	Unacceptable condition	C1 or C2	Improvement recommended	C3	Further investigation	FI	Not verified	N/V	Limitation	LIM	Not applicable	N/A
----------------------	------	------------------------	----------	-------------------------	----	-----------------------	----	--------------	-----	------------	-----	----------------	-----

**16 INSPECTION SCHEDULE (CONTINUED)**

Item	Description	Comment	Outcome
8.3	Emergency switching/stopping (Section 465; 537.3.3):		
8.3.1	Presence and condition of appropriate devices (Section 465; 537.3.3; 537.4)	N/A	N/A
8.3.2	Readily accessible for operation where danger might occur (537.3.3.6)	N/A	N/A
8.3.3	Correct operation verified (643.10)	N/A	N/A
8.3.4	Clearly identified by position and/or durable marking (537.3.3.6)	N/A	N/A
8.4	Functional switching (Section 463; 537.3.1):		
8.4.1	Presence and condition of appropriate devices (537.3.1.1; 537.3.1.2)	N/A	✓
8.4.2	Correct operation verified (537.3.1.1; 537.3.1.2)	N/A	✓
9.0	CURRENT-USING EQUIPMENT (PERMANENTLY CONNECTED)		
9.1	Condition of equipment in terms of IP rating etc (416.2)	N/A	✓
9.2	Equipment does not constitute a fire hazard (Section 421)	N/A	✓
9.3	Enclosure not damaged/deteriorated so as to impair safety (134.1.1; 416.2; 512.2)	N/A	✓
9.4	Suitability for the environment and external influences (512.2)	N/A	✓
9.5	Security of fixing (134.1.1)	N/A	✓
9.6	Cable entry holes in ceiling above luminaires, sized or sealed so as to restrict the spread of fire: List number and location of luminaires inspected (separate page) (527.2)	N/A	✓
9.7	Recessed luminaires (downlighters):		
9.7.1	Correct type of lamps fitted (559.3.1)	N/A	N/A
9.7.2	Installed to minimise build-up of heat by use of 'fire rated' fittings, insulation displacement box or similar (421.1.2)	N/A	N/A
9.7.3	No signs of overheating to surrounding building fabric (559.4.1)	N/A	N/A
9.7.4	No signs of overheating to conductors/terminations (526.1)	N/A	N/A
10.0	LOCATION(S) CONTAINING A BATH OR SHOWER		
10.1	Additional protection for all low voltage (LV) circuits by RCD not exceeding 30mA (701.411.3.3)	N/A	N/A
10.2	Where used as a protective measure, requirements for SELV or PELV met (701.414.4.5)	N/A	N/A
10.3	Shaver sockets comply with BS EN 61558-2-5 formerly BS 3535 (701.512.3)	N/A	N/A
10.4	Presence of supplementary bonding conductors, unless not required by BS 7671: 2018 (701.415.2)	N/A	N/A
10.5	Low voltage (e.g. 230 volt) socket-outlets sited at least 3m from zone 1 (701.512.3)	N/A	N/A
10.6	Suitability of equipment for external influences for installed location in terms of IP rating (701.512.2)	N/A	N/A
10.7	Suitability of accessories and controlgear etc. for a particular zone (701.512.3)	N/A	N/A
10.8	Suitability of current-using equipment for particular position within the location (701.55)	N/A	N/A
11.0	OTHER PART 7 SPECIAL INSTALLATIONS OR LOCATIONS List all other special installation or locations present, if any. (Record separately the results of particular inspections)		
11.1	N/A	N/A	N/A
11.2	N/A	N/A	N/A
11.3	N/A	N/A	N/A

OUTCOMES													
Acceptable condition	TICK	Unacceptable condition	C1 or C2	Improvement recommended	C3	Further investigation	FI	Not verified	N/V	Limitation	LIM	Not applicable	N/A

## 17 SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation:

D.B. 1

Location:

Stage

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices	RCD	Maximum Z <sub>s</sub> permitted by BS7671	Circuit impedances (Ohms)					Insulation resistance			Polarity	Maximum measured earth fault loop impedance Z <sub>s</sub>	RCD		AFDD								
					Live	cpc	Max disconnect time permitted by BS7671				BS(EN)	Type No	Rating	Capacity	Operating current, I <sub>Δn</sub>	Ring final circuits only (measured end to end)					All circuits (one column to be completed)			Live - Live	Live - Earth	Test voltage	Disconnection time	Test button operation			
																γ <sub>1</sub>	γ <sub>n</sub>	γ <sub>2</sub>			R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>							MΩ	MΩ	V
																(Line)	(Neutral)	(cpc)													
1	DIM 1	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.52	N/A	> 200	> 200	500	✓	0.86	27.5	✓	N/A					
2	DIM 2	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.52	N/A	> 200	> 200	500	✓	0.86	27.5	✓	N/A					
3	DIM 3	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.50	N/A	> 200	> 200	500	✓	0.84	27.5	✓	N/A					
4	DIM 4	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.56	N/A	> 200	> 200	500	✓	0.90	27.5	✓	N/A					
5	DIM 5	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.56	N/A	> 200	> 200	500	✓	0.90	27.5	✓	N/A					
6	DIM 6	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.56	N/A	> 200	> 200	500	✓	0.90	27.5	✓	N/A					
7	SKT 1	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.60	N/A	> 200	> 200	500	✓	0.94	27.5	✓	N/A					
8	SKT 2	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.69	N/A	> 200	> 200	500	✓	1.03	27.5	✓	N/A					
9	SKT 3	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.70	N/A	> 200	> 200	500	✓	1.04	27.5	✓	N/A					
10	SKT 4	A	B	1	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.72	N/A	> 200	> 200	500	✓	1.06	27.5	✓	N/A					
11	FLLURESCENT STAGE LIGHT	A	B	2	2.5	2.5	0.4	60898	B	16	10	30	2.18				0.49	N/A	> 200	> 200	500	✓	0.83	27.5	✓	N/A					

CODES FOR TYPE OF WIRING	A	B	C	D	E	F	G	H	O - Other
	Thermoplastic insulated/sheathed cables	Thermoplastic cables in metallic conduit	Thermoplastic cables in nonmetallic conduit	Thermoplastic cables in metallic trunking	Thermoplastic cables in nonmetallic trunking	Thermoplastic /SWA cables	Thermosetting /SWA cables	Mineral insulated cables	N/A

## 18 BOARD CHARACTERISTICS

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	ISOLATOR A - 1 L1	No of phases:	N/A	Confirmation of supply polarity:	N/A
Overcurrent protective device for the distribution circuit:	BS(EN): 1361 - Type 2	Rating:	60 A	Nominal Voltage:	N/A V
RCD	BS(EN): N/A	No of poles:	N/A	Rating:	N/A mA
				Z <sub>s</sub> :	0.43 Ω
				Disconnection time at In:	N/A ms
				Disconnection time at 5I <sub>n</sub> :	N/A ms

## 19 DETAILS OF TEST INSTRUMENTS

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	6111-771-081008/3165	Insulation resistance:	N/A	Continuity:	N/A
Earth electrode resistance:	N/A	Earth fault loop impedance:	N/A	RCD:	N/A

## 20 TESTED BY

Name:	Carl Mchenry	Position:	Qualified Supervisor	Signature:		Date:	14/07/2022
-------	--------------	-----------	----------------------	------------	--	-------	------------

## SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation: D.B. 1

Location: Stage

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices					RCD	Maximum $Z_s$ permitted by BS7671	Circuit impedances (Ohms)					Insulation resistance			Polarity	RCD		AFDD			
					Live mm <sup>2</sup>	cpc mm <sup>2</sup>	Max disconnect time permitted by BS7671 s	BS(EN)	Type No	Rating A	Capacity kA	Operating current, $I_{Δn}$ mA			Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live MΩ	Live - Earth MΩ	Test voltage V		Maximum measured earth fault loop impedance $Z_s$ Ω	Disconnection time ms	Test button operation	Test button operation		
															$r_1$	$r_n$	$r_2$	$R_1+R_2$	$R_2$									Test button operation	Test button operation
															(Line)	(Neutral)	(cpc)												
12	BULK HEAD STAGE LIGHT	A	B	2	1.5	1.5	0.4	60898	B	16	10	30	2.18				0.74	N/A	> 200	> 200	500	✓	1.08	27.5	✓	N/A			
N/A	N/A																												

CODES FOR TYPE OF WIRING	A Thermoplastic insulated/sheathed cables	B Thermoplastic cables in metallic conduit	C Thermoplastic cables in nonmetallic conduit	D Thermoplastic cables in metallic trunking	E Thermoplastic cables in nonmetallic trunking	F Thermoplastic /SWA cables	G Thermosetting /SWA cables	H Mineral insulated cables	O - Other
									N/A

## SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation:

**D.B. 2**

Location:

**Corridor**

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices					RCD	Circuit impedances (Ohms)					Insulation resistance			Polarity	RCD		AFDD			
					Live mm <sup>2</sup>	cpc mm <sup>2</sup>	Max disconnect time permitted by BS7671 s	BS(EN)	Type No	Rating A	Capacity kA	Operating current, I <sub>Δn</sub> mA		Maximum Z <sub>s</sub> permitted by BS7671 Ω	Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live MΩ	Live - Earth MΩ		Test voltage V	Maximum measured earth fault loop impedance Z <sub>s</sub> Ω		Disconnection time ms	Test button operation ✓	Test button operation ✓
															γ <sub>1</sub> (Line)	γ <sub>n</sub> (Neutral)	γ <sub>2</sub> (cpc)	R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>									
															✓	✓	✓	✓	✓									
1 L1	LADIES LOO HEATER	A	B	1	2.5	1.5	0.4	60898	B	20	6	30	1.75				1.26	N/A	> 200	> 200	500	✓	1.64	44.4	✓	N/A		
2 L1	LIGHTS & Emergency lights	A	B	28	1.0	1.0	0.4	60898	B	6	6	30	5.82				1.24	N/A	10.2	5.66	500	✓	1.57	44.4	✓	N/A		
3 L1	GENTS LOO HEATER	A	B	1	2.5	1.5	0.4	60898	B	20	6	30	1.75				1.38	N/A	> 200	> 200	500	✓	1.69	44.4	✓	N/A		
4 L1	SOCKETS BY STAGE	A	B	12	2.5	1.5	0.4	60898	B	20	6	30	1.75				0.87	N/A	> 200	> 200	500	✓	1.25	44.4	✓	N/A		
5 L1	DISABLED LOO HEATER	A	B	1	2.5	1.5	0.4	60898	B	20	6	30	1.75				1.47	N/A	> 200	> 200	500	✓	1.85	44.4	✓	N/A		
6 L1	EXTENSION SOCKETS	A	B		2.5	1.5	0.4	60898	B	20	6	30	1.75				1.26	N/A	> 200	> 200	500	✓	1.64	44.4	✓	N/A		
7 L1	SOCKETS PROP ROOM	A	B	4	2.5	1.5	0.4	60898	B	16	6	30	2.18				0.93	N/A	> 200	> 200	500	✓	1.31	44.4	✓	N/A		
8 L1	LIGHTS KITCHEN	A	B	5	1.0	1.0	0.4	60898	B	6	6	30	5.82				1.73	N/A	11.6	13.54	500	✓	2.11	35.8	✓	N/A		
9 L1	OUTSIDE LIGHTS	A	B	4	1.0	1.0	0.4	60898	B	6	6	30	5.82				1.20	N/A	8.66	10.25	500	✓	1.48	35.8	✓	N/A		
10 L1	SOCKETS KITCHEN	A	B	4	2.5	1.5	0.4	60898	B	16	6	30	2.18				0.93	N/A	78.5	65.2	500	✓	1.31	35.8	✓	N/A		

CODES FOR TYPE OF WIRING	A Thermoplastic insulated/sheathed cables	B Thermoplastic cables in metallic conduit	C Thermoplastic cables in nonmetallic conduit	D Thermoplastic cables in metallic trunking	E Thermoplastic cables in nonmetallic trunking	F Thermoplastic /SWA cables	G Thermosetting /SWA cables	H Mineral insulated cables	O - Other
									N/A

### BOARD CHARACTERISTICS

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	Origin		No of phases:	1	Confirmation of supply polarity:	N/A
Overcurrent protective device for the distribution circuit:	BS(EN):	N/A	Rating:	N/A A	Nominal Voltage:	230 V
RCD	BS(EN):	N/A	No of poles:	N/A	Rating:	N/A mA
					Z <sub>s</sub> :	N/A Ω
					Disconnection time at In:	N/A ms
					Disconnection time at 5I <sub>n</sub> :	N/A ms

### DETAILS OF TEST INSTRUMENTS

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	6111-771-081008/3165	Insulation resistance:	N/A	Continuity:	N/A
Earth electrode resistance:	N/A	Earth fault loop impedance:	N/A	RCD:	N/A

### TESTED BY

Name:	Carl Mchenry	Position:	Qualified Supervisor	Signature:		Date:	14/07/2022
-------	--------------	-----------	----------------------	------------	--	-------	------------

**SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS**

Distribution board designation:

D.B. 2

Location:

Corridor

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices					RCD	Maximum $Z_s$ permitted by BS7671 $\Omega$	Circuit impedances (Ohms)					Insulation resistance			Polarity	Maximum measured earth fault loop impedance $Z_s$ $\Omega$	Disconnection time ms	RCD Test button operation	AFDD Test button operation					
					Live mm <sup>2</sup>	cpc mm <sup>2</sup>	Max disconnect time permitted by BS7671 s	BS(EN)	Type No	Rating A	Capacity kA	Operating current, $I_{\Delta n}$ mA			Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live M $\Omega$	Live - Earth M $\Omega$	Test voltage V										
															$r_1$ (Line)	$r_n$ (Neutral)	$r_2$ (cpc)	$R_1+R_2$	$R_2$													
11 L1	SOCKETS - DOUBLE POLE SWITCH BY DOOR	A	B	12	2.5	1.5	0.4	60898	B	16	6	30	2.18				0.87	N/A	> 200	> 200	500	✓	1.25	35.8	✓	N/A						
12 L1	SOCKETS BY BOILER	A	B	2	2.5	1.5	0.4	60898	B	20	6	30	1.75				0.74	N/A	> 200	> 200	500	✓	1.12	35.8	✓	N/A						
13 L1	LIGHTS	A	B	16	2.5	1.5	0.4	60898	B	20	6	30	1.75				0.67	N/A	105	188	500	✓	0.97	35.8	✓	N/A						
14 L1	HEATER	A	B	1	2.5	1.5	0.4	60898	B	20	6	30	1.75				0.54	N/A	> 200	> 200	500	✓	0.98	35.8	✓	N/A						
15 L1	SOCKETS	A	B	1	2.5	1.5	0.4	60898	B	16	6	30	2.18				1.32	N/A	> 200	> 200	500	✓	1.62	35.8	✓	N/A						
16 L1	EXENSION LIGHTS	A	B		1.0	1.0	0.4	60898	B	6	6	30	5.82				1.94	N/A	> 200	> 200	500	✓	2.22	35.8	✓	N/A						
N/A	N/A																															

CODES FOR TYPE OF WIRING	A Thermoplastic insulated/sheathed cables	B Thermoplastic cables in metallic conduit	C Thermoplastic cables in nonmetallic conduit	D Thermoplastic cables in metallic trunking	E Thermoplastic cables in nonmetallic trunking	F Thermoplastic /SWA cables	G Thermosetting /SWA cables	H Mineral insulated cables	O - Other
									N/A

## SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation:

**ISOLATOR A**

Location:

**STAGE**

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices					RCD	Circuit impedances (Ohms)					Insulation resistance			Polarity	Maximum measured earth fault loop impedance Z <sub>s</sub>	RCD		AFDD						
					Live	cpc	Max disconnect time permitted by BS7671	BS(EN)	Type No	Rating	Capacity	Operating current, I <sub>Δn</sub>		Maximum Z <sub>s</sub> permitted by BS7671	Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live	Live - Earth			Test voltage	✓		ms	✓	✓			
															mm <sup>2</sup>	mm <sup>2</sup>	s	Ω	Ω											Ω	Ω	Ω
															(Line)	(Neutral)	(cpc)	R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>											MΩ	MΩ	V
1 L1	Supply to DB stage lighting (Supply to D.B. 1)	A	B	1	25	16	0.4	1361	2	60	33	30	N/A				0.01		> 200	> 200	500	✓	0.43	N/A	N/A	N/A						
N/A	N/A																															

CODES FOR TYPE OF WIRING	A	B	C	D	E	F	G	H	O - Other
	Thermoplastic insulated/sheathed cables	Thermoplastic cables in metallic conduit	Thermoplastic cables in nonmetallic conduit	Thermoplastic cables in metallic trunking	Thermoplastic cables in nonmetallic trunking	Thermoplastic /SWA cables	Thermosetting /SWA cables	Mineral insulated cables	N/A

### BOARD CHARACTERISTICS

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	Origin		No of phases:	1	Confirmation of supply polarity:	N/A
Overcurrent protective device for the distribution circuit:	BS(EN):	N/A	Rating:	N/A A	Nominal Voltage:	230 V
RCD	BS(EN):	N/A	No of poles:	N/A	Rating:	N/A mA
					Z <sub>s</sub> :	N/A Ω
					Disconnection time at In:	N/A ms
					Disconnection time at 5I <sub>n</sub> :	N/A ms

### DETAILS OF TEST INSTRUMENTS

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	6111-771-081008/3165	Insulation resistance:	N/A	Continuity:	N/A
Earth electrode resistance:	N/A	Earth fault loop impedance:	N/A	RCD:	N/A

### TESTED BY

Name:	Carl Mchenry	Position:	Qualified Supervisor	Signature:		Date:	14/07/2022
-------	--------------	-----------	----------------------	------------	--	-------	------------

## SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation: **ISOLATOR C**

Location: **STAGE**

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa		Max disconnect time permitted by BS7671 s	Overcurrent protective devices				RCD Maximum Z <sub>s</sub> permitted by BS7671 Ω	Circuit impedances (Ohms)					Insulation resistance			Polarity ✓	Maximum measured earth fault loop impedance Z <sub>s</sub> Ω	RCD		AFDD Test button operation ✓			
					Live mm <sup>2</sup>	cpc mm <sup>2</sup>		BS(EN)	Type No	Rating A	Capacity kA		Operating current, I <sub>Δn</sub> mA	Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live MΩ	Live - Earth MΩ			Test voltage V	Disconnection time ms		Test button operation ✓		
														r <sub>1</sub> (Line)	r <sub>n</sub> (Neutral)	r <sub>2</sub> (cpc)	R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>										
					Ω	Ω		Ω	Ω	Ω																		
1 L1	DB GARAGE (Supply to D.B. D)	A	E	1	16	Armour	0.4	1361	2	60	33	N/A	N/A				0.20		> 200	> 200	500	✓	0.53	N/A	N/A	N/A		
N/A	N/A																											

CODES FOR TYPE OF WIRING	A Thermoplastic insulated/sheathed cables	B Thermoplastic cables in metallic conduit	C Thermoplastic cables in nonmetallic conduit	D Thermoplastic cables in metallic trunking	E Thermoplastic cables in nonmetallic trunking	F Thermoplastic /SWA cables	G Thermosetting /SWA cables	H Mineral insulated cables	O - Other
									N/A

### BOARD CHARACTERISTICS

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	Origin	No of phases:	1	Confirmation of supply polarity:	N/A
Overcurrent protective device for the distribution circuit:	BS(EN): N/A	Rating:	N/A A	Nominal Voltage:	N/A V
RCD	BS(EN): N/A	No of poles:	N/A	Rating:	N/A mA
		Z <sub>s</sub> :	N/A Ω	lpf:	N/A
		Disconnection time at I <sub>n</sub> :	N/A ms	Disconnection time at 5I <sub>n</sub> :	N/A ms

### DETAILS OF TEST INSTRUMENTS

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	6111-771-081008/3165	Insulation resistance:	N/A	Continuity:	N/A
Earth electrode resistance:	N/A	Earth fault loop impedance:	N/A	RCD:	N/A

### TESTED BY

Name:	Carl Mchenry	Position:	Qualified Supervisor	Signature:		Date:	14/07/2022
-------	--------------	-----------	----------------------	------------	--	-------	------------



### SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation:

**D.B. D**

Location:

**GARAGE**

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Max disconnect time permitted by BS7671 s	Overcurrent protective devices					RCD	Maximum Z <sub>s</sub> permitted by BS7671 Ω	Circuit impedances (Ohms)					Insulation resistance			Polarity	Maximum measured earth fault loop impedance Z <sub>s</sub> Ω	Disconnection time ms	RCD Test button operation	AFDD Test button operation	
					Live mm <sup>2</sup>	cpc mm <sup>2</sup>	BS(EN)		Type No	Rating A	Capacity kA	Operating current, I <sub>Δn</sub> mA	Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live MΩ	Live - Earth MΩ	Test voltage V									
													r <sub>1</sub> (Line)			r <sub>n</sub> (Neutral)	r <sub>2</sub> (cpc)				R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>							
																							✓						✓
1 L1	OUTBUILDINGS (Supply to D.B. E, D.B. F)	F	C	2	6	6	0.4	60898	B	32	6	30	1.10				0.05	N/A	> 200	> 200	500	✓	0.41	27.5	✓	N/A			
2 L1	SOCKET	A	C	1	2.5	1.5	0.4	60898	B	16	6	30	2.18				0.52	N/A	> 200	> 200	500	✓	0.95	27.5	✓	N/A			
3 L1	LIGHT	A	C	1	1.5	1.0	0.4	60898	B	6	6	30	5.82				0.60	N/A	> 200	> 200	500	✓	1.05	27.5	✓	N/A			
N/A	N/A																												

CODES FOR TYPE OF WIRING	A Thermoplastic insulated/sheathed cables	B Thermoplastic cables in metallic conduit	C Thermoplastic cables in nonmetallic conduit	D Thermoplastic cables in metallic trunking	E Thermoplastic cables in nonmetallic trunking	F Thermoplastic /SWA cables	G Thermosetting /SWA cables	H Mineral insulated cables	O - Other
									N/A

### BOARD CHARACTERISTICS

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	<b>ISOLATOR C - 1 L1</b>			No of phases:	<b>1</b>	Confirmation of supply polarity:	<input checked="" type="checkbox"/>				
Overcurrent protective device for the distribution circuit:	BS(EN):	<b>1361 - Type 2</b>		Rating:	<b>60 A</b>	Nominal Voltage:	<b>230 V</b>	Z <sub>s</sub> :	<b>0.53 Ω</b>	lpf:	<b>0.58 kA</b>
RCD	BS(EN):	<b>N/A</b>		No of poles:	<b>N/A</b>	Rating:	<b>N/A mA</b>	Disconnection time at In:	<b>N/A ms</b>	Disconnection time at 5I <sub>n</sub> :	<b>N/A ms</b>

### DETAILS OF TEST INSTRUMENTS

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	<b>6111-771-081008/3165</b>	Insulation resistance:	<b>N/A</b>	Continuity:	<b>N/A</b>
Earth electrode resistance:	<b>N/A</b>	Earth fault loop impedance:	<b>N/A</b>	RCD:	<b>N/A</b>

### TESTED BY

Name:	<b>Carl Mchenry</b>	Position:	<b>Qualified Supervisor</b>	Signature:		Date:	<b>14/07/2022</b>
-------	---------------------	-----------	-----------------------------	------------	--	-------	-------------------

## SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS

Distribution board designation:

**D.B. E**

Location:

**SHED**

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices					RCD	Circuit impedances (Ohms)					Insulation resistance			Polarity	RCD		AFDD									
					Live mm <sup>2</sup>	cpc mm <sup>2</sup>	Max disconnect time permitted by BS7671 s	BS(EN)	Type No	Rating A	Capacity kA	Operating current, I <sub>Δn</sub> mA		Maximum Z <sub>s</sub> permitted by BS7671 Ω	Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live MΩ	Live - Earth MΩ		Test voltage V	Maximum measured earth fault loop impedance Z <sub>s</sub> Ω		Disconnection time ms	Test button operation	Test button operation						
															r <sub>1</sub> (Line)	r <sub>n</sub> (Neutral)	r <sub>2</sub> (cpc)	R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>															
1 L1	SOCKETS	A	C	1	2.5	1.5	0.4	60898	B	16	6	30	2.18				0.92	N/A	> 200	> 200	500	✓	1.38	22.3	✓	N/A								
2 L1	LIGHTS	A	C	2	1.5	1.0	0.4	60898	B	6	6	30	5.82				1.44	N/A	> 200	> 200	500	✓	1.89	22.3	✓	N/A								
N/A	N/A																																	

CODES FOR TYPE OF WIRING	A	B	C	D	E	F	G	H	O - Other
	Thermoplastic insulated/sheathed cables	Thermoplastic cables in metallic conduit	Thermoplastic cables in nonmetallic conduit	Thermoplastic cables in metallic trunking	Thermoplastic cables in nonmetallic trunking	Thermoplastic /SWA cables	Thermosetting /SWA cables	Mineral insulated cables	N/A

### BOARD CHARACTERISTICS

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	<b>D.B. D - 1 L1</b>	No of phases:	<b>1</b>	Confirmation of supply polarity:	<input checked="" type="checkbox"/>
Overcurrent protective device for the distribution circuit:	BS(EN): <b>60898 - Type B</b>	Rating:	<b>32 A</b>	Nominal Voltage:	<b>230 V</b>
RCD	BS(EN): <b>N/A</b>	No of poles:	<b>N/A</b>	Disconnection time at In:	<b>27.5 ms</b>
				Disconnection time at 5I <sub>n</sub> :	<b>N/A ms</b>
				Z <sub>s</sub> :	<b>0.41 Ω</b>
				Ip <sub>f</sub> :	<b>0.58 kA</b>

### DETAILS OF TEST INSTRUMENTS

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	6111-771-081008/3165	Insulation resistance:	N/A	Continuity:	N/A
Earth electrode resistance:	N/A	Earth fault loop impedance:	N/A	RCD:	N/A

### TESTED BY

Name:	Carl Mchenry	Position:	Qualified Supervisor	Signature:		Date:	14/07/2022
-------	--------------	-----------	----------------------	------------	--	-------	------------

**SCHEDULE OF CIRCUIT DETAILS AND TEST RESULTS**

Distribution board designation:

D.B. F

Location:

SHED

Circuit number and phase	Circuit designation	Type of wiring	Reference Method	Number of points served	Circuit conductors: csa			Overcurrent protective devices					RCD	Circuit impedances (Ohms)					Insulation resistance			Polarity	RCD		AFDD												
					Live	cpc	Max disconnect time permitted by BS7671	BS(EN)	Type No	Rating	Capacity	Operating current, I <sub>Δn</sub>		Maximum Z <sub>s</sub> permitted by BS7671	Ring final circuits only (measured end to end)			All circuits (one column to be completed)		Live - Live	Live - Earth		Test voltage	Maximum measured earth fault loop impedance Z <sub>s</sub>		Disconnection time	Test button operation										
															mm <sup>2</sup>	mm <sup>2</sup>	s	R <sub>1</sub>	R <sub>n</sub>									R <sub>2</sub>	R <sub>1</sub> +R <sub>2</sub>	R <sub>2</sub>	MΩ	MΩ	V	Ω	ms	✓	✓
1 L1	SOCKETS	A	C	2	2.5	1.5	0.4	60898	B	16	6		2.18				0.26		> 200	> 200	500	✓	2.13	22.5	✓	N/A											
2 L1	LIGHTS	A	C	4	1.0	1.0	0.4	60898	B	6	6	30	5.82				0.45		> 200	> 200	500	✓	1.34	22.5	✓	N/A											
N/A	N/A																																				

CODES FOR TYPE OF WIRING	A	B	C	D	E	F	G	H	O - Other
	Thermoplastic insulated/sheathed cables	Thermoplastic cables in metallic conduit	Thermoplastic cables in nonmetallic conduit	Thermoplastic cables in metallic trunking	Thermoplastic cables in nonmetallic trunking	Thermoplastic /SWA cables	Thermosetting /SWA cables	Mineral insulated cables	N/A

**BOARD CHARACTERISTICS**

APPLIES WHEN THE BOARD IS NOT CONNECTED TO THE ORIGIN OF THE INSTALLATION

Supply to this distribution board is from:	D.B. D - 1 L1	No of phases:	1	Confirmation of supply polarity:	✓
Overcurrent protective device for the distribution circuit:	BS(EN): 60898 - Type B	Rating:	32 A	Nominal Voltage:	230 V
RCD	BS(EN): N/A	No of poles:	N/A	Rating:	N/A mA
				Z <sub>s</sub> :	0.41 Ω
				Disconnection time at In:	27.5 ms
				lpf:	0.58 kA
				Disconnection time at 5I <sub>n</sub> :	N/A ms


**DETAILS OF TEST INSTRUMENTS**

Details of Test Instruments used (state serial and/or asset numbers):

Multi-functional:	6111-771-081008/3165	Insulation resistance:	N/A	Continuity:	N/A
Earth electrode resistance:	N/A	Earth fault loop impedance:	N/A	RCD:	N/A

**TESTED BY**


Name:	Carl Mchenry	Position:	Qualified Supervisor	Signature:		Date:	14/07/2022
-------	--------------	-----------	----------------------	------------	--	-------	------------

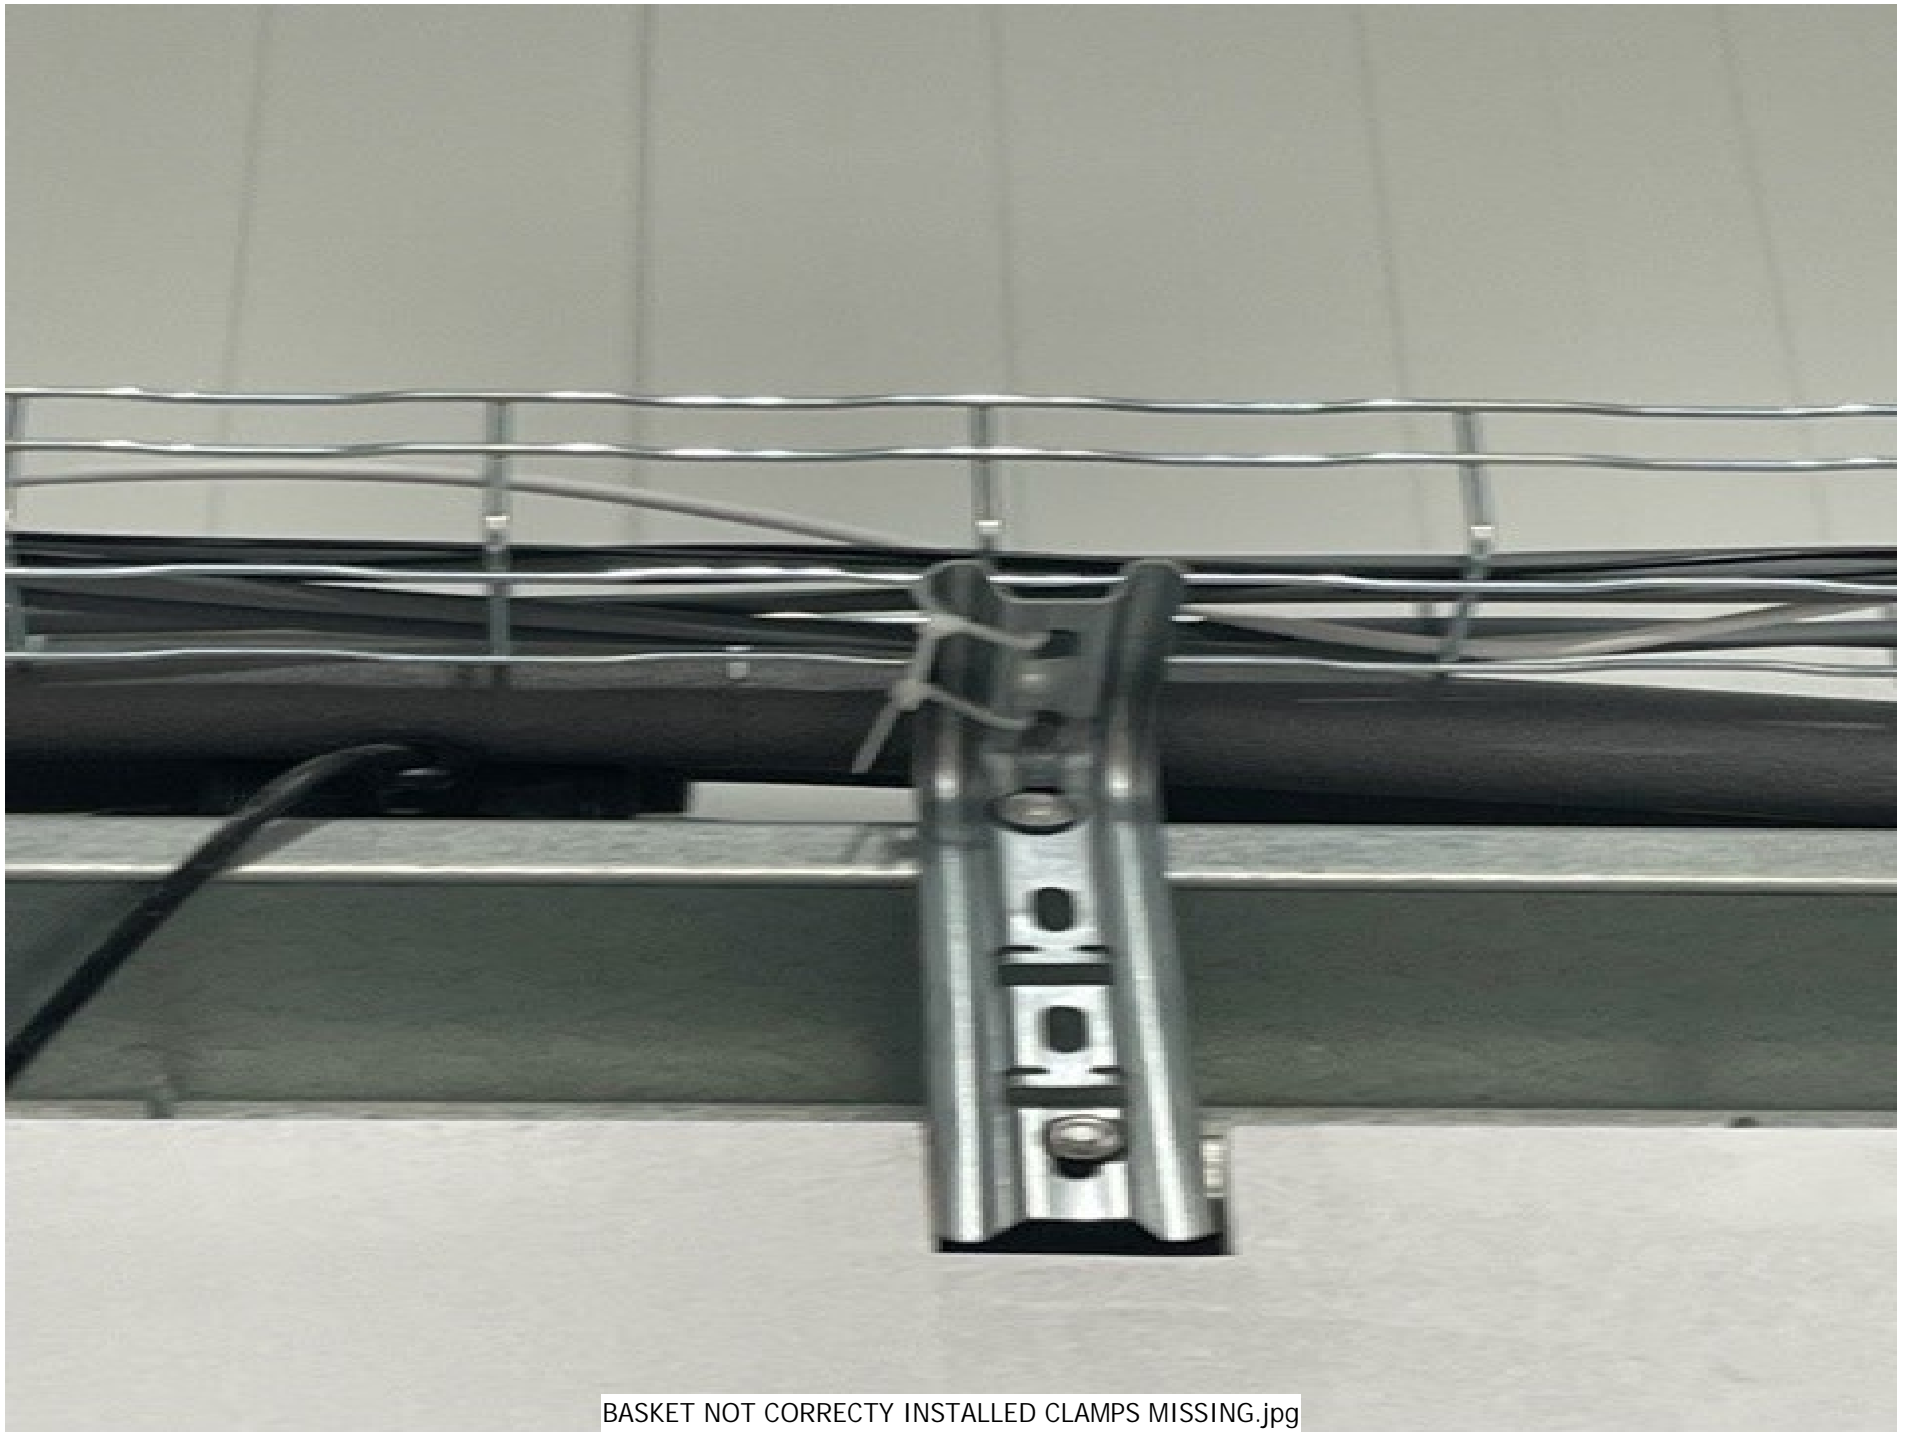


BASKET NOT CORRECTY INSTALLED CLAMPS MISSING.jpg




CABLE NOT SUPPORTED.jpg

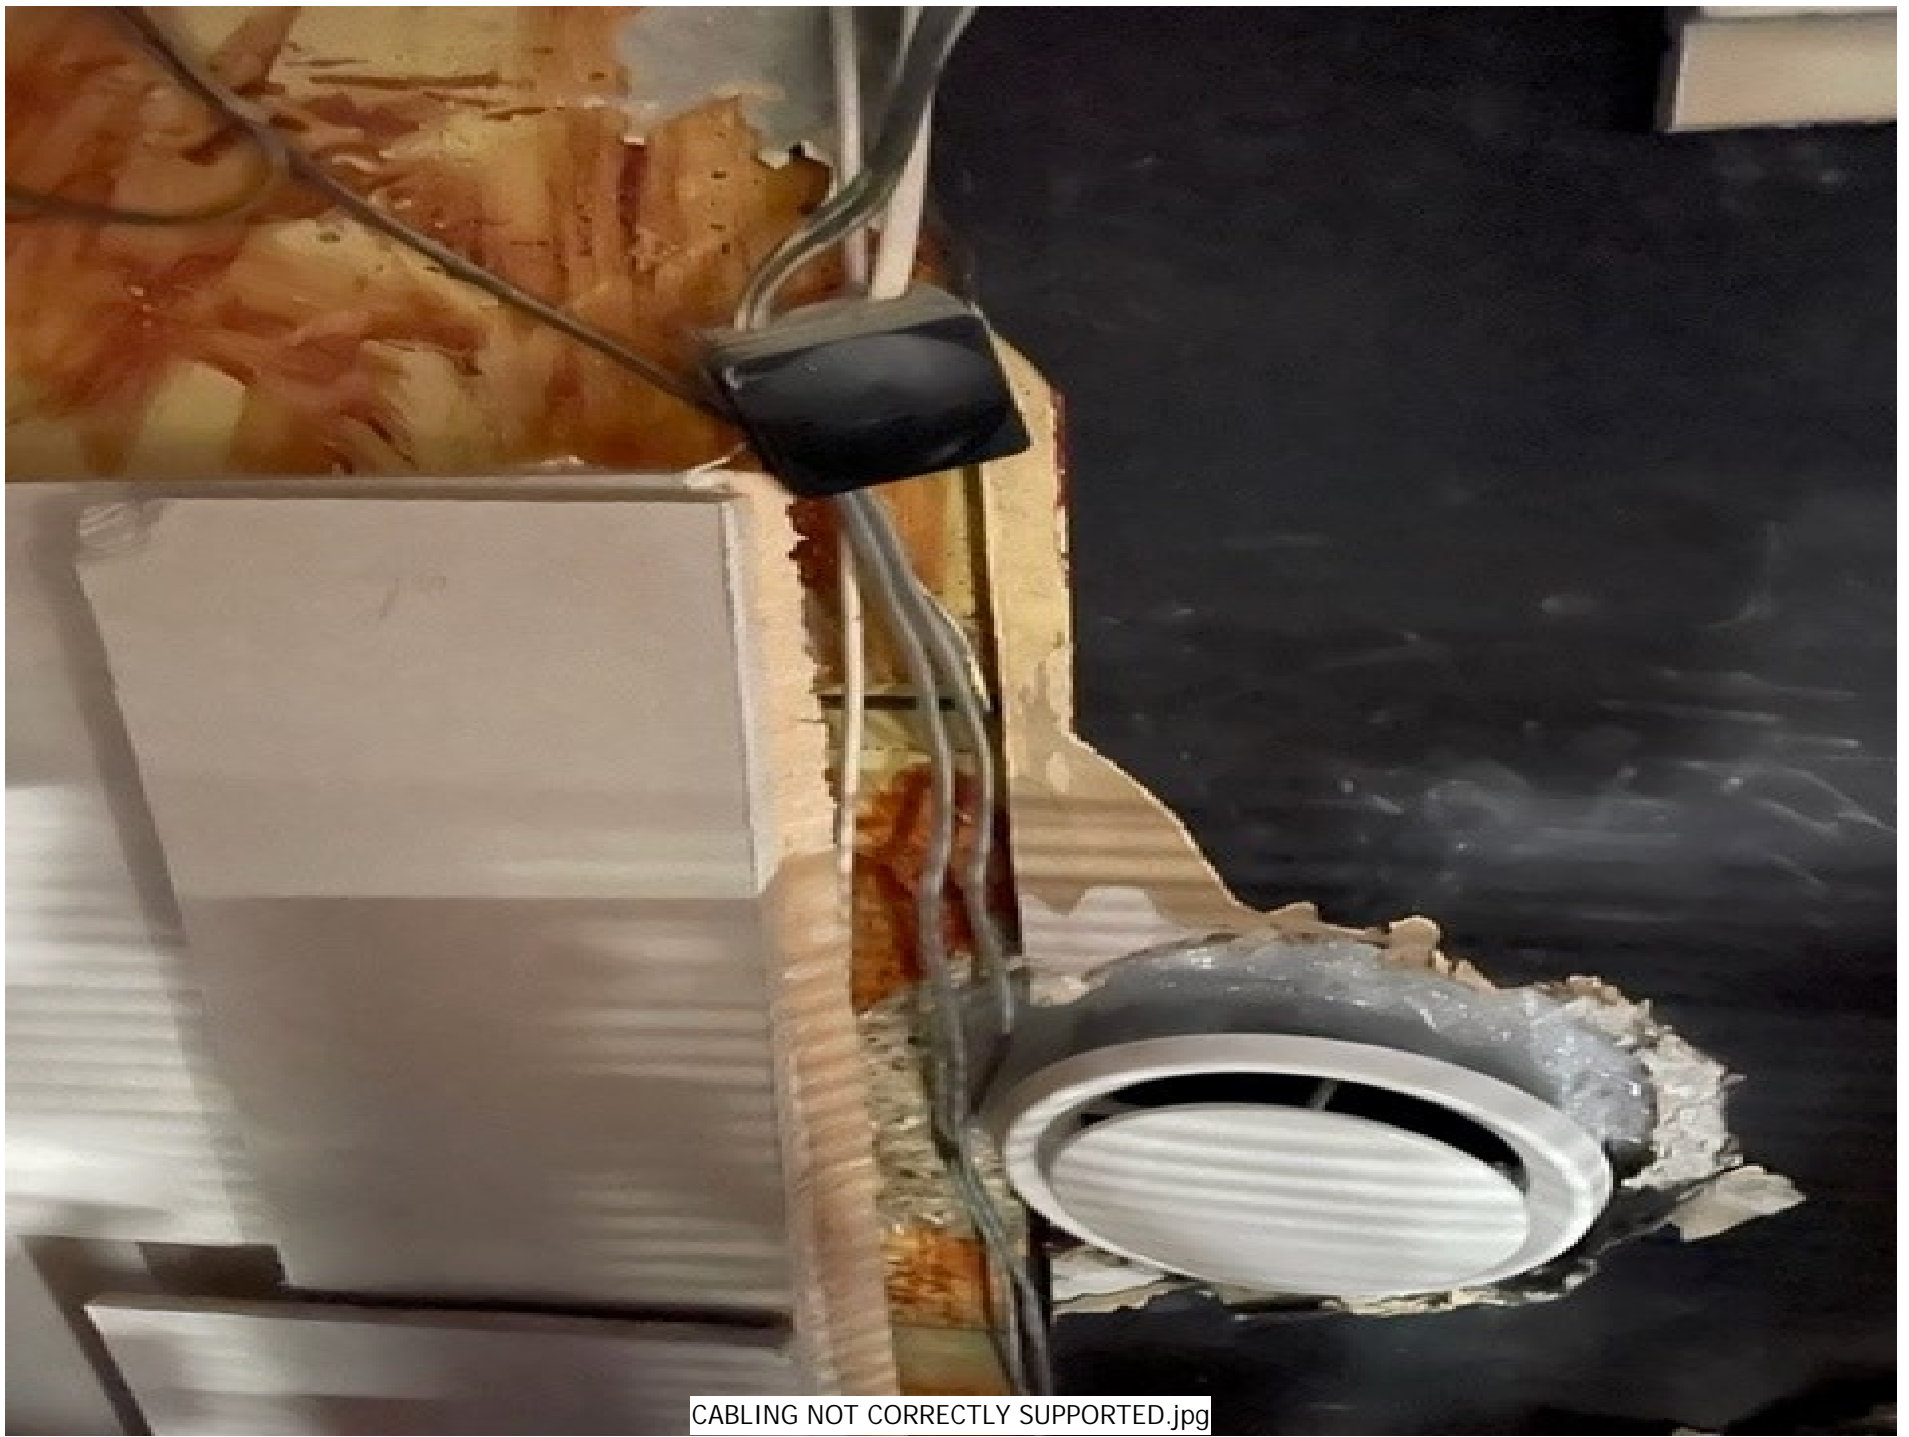

CABLING NOT CORRECTLY SUPPORTED.jpg

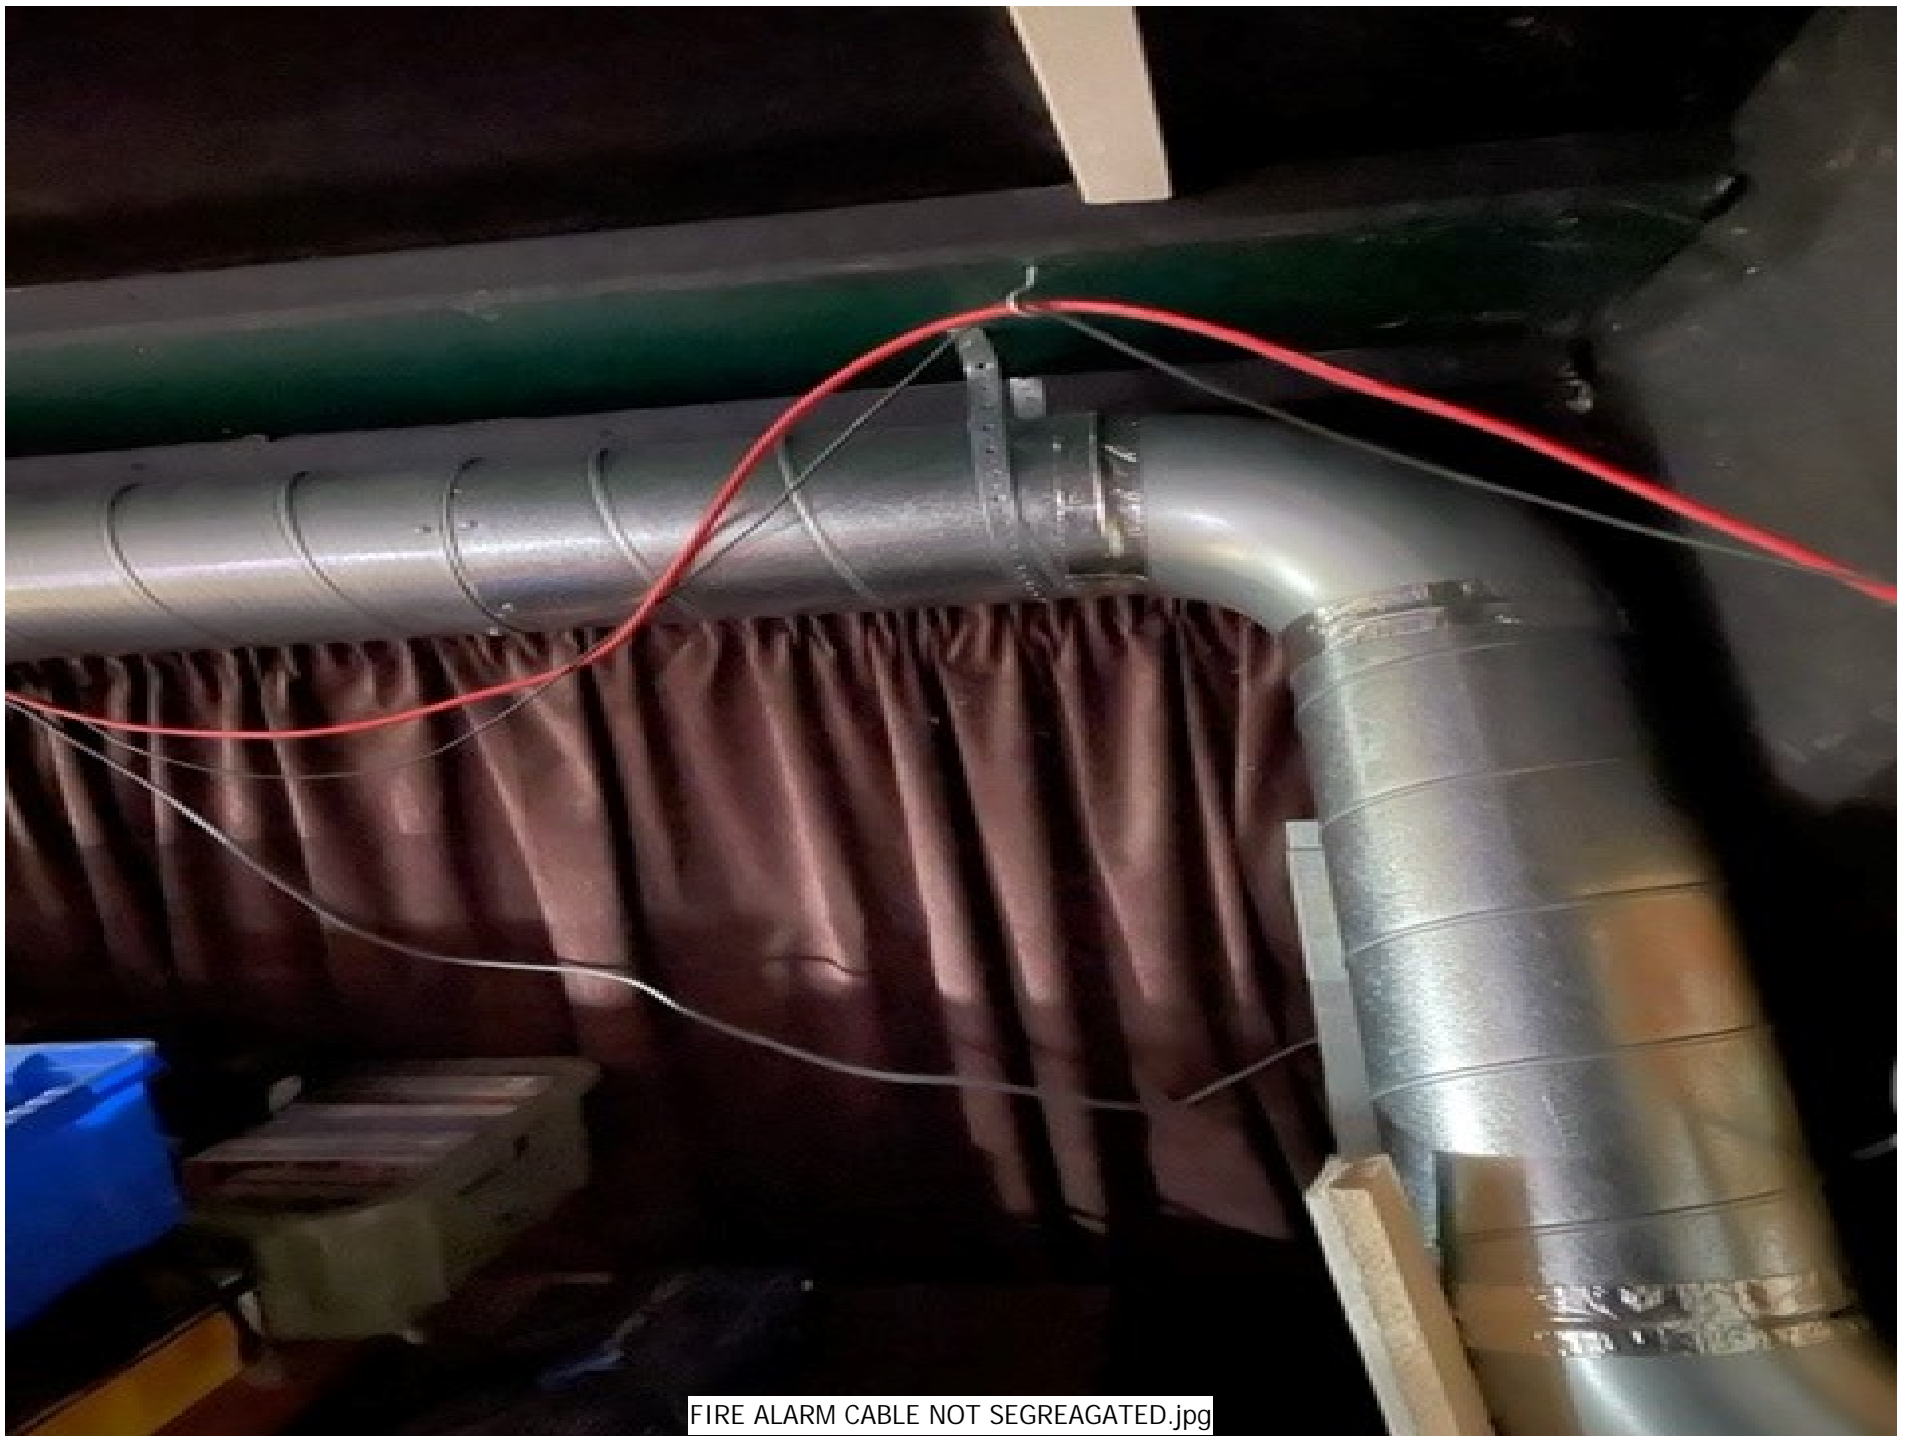

FIRE ALARM CABLE NOT SEGREGATED.jpg

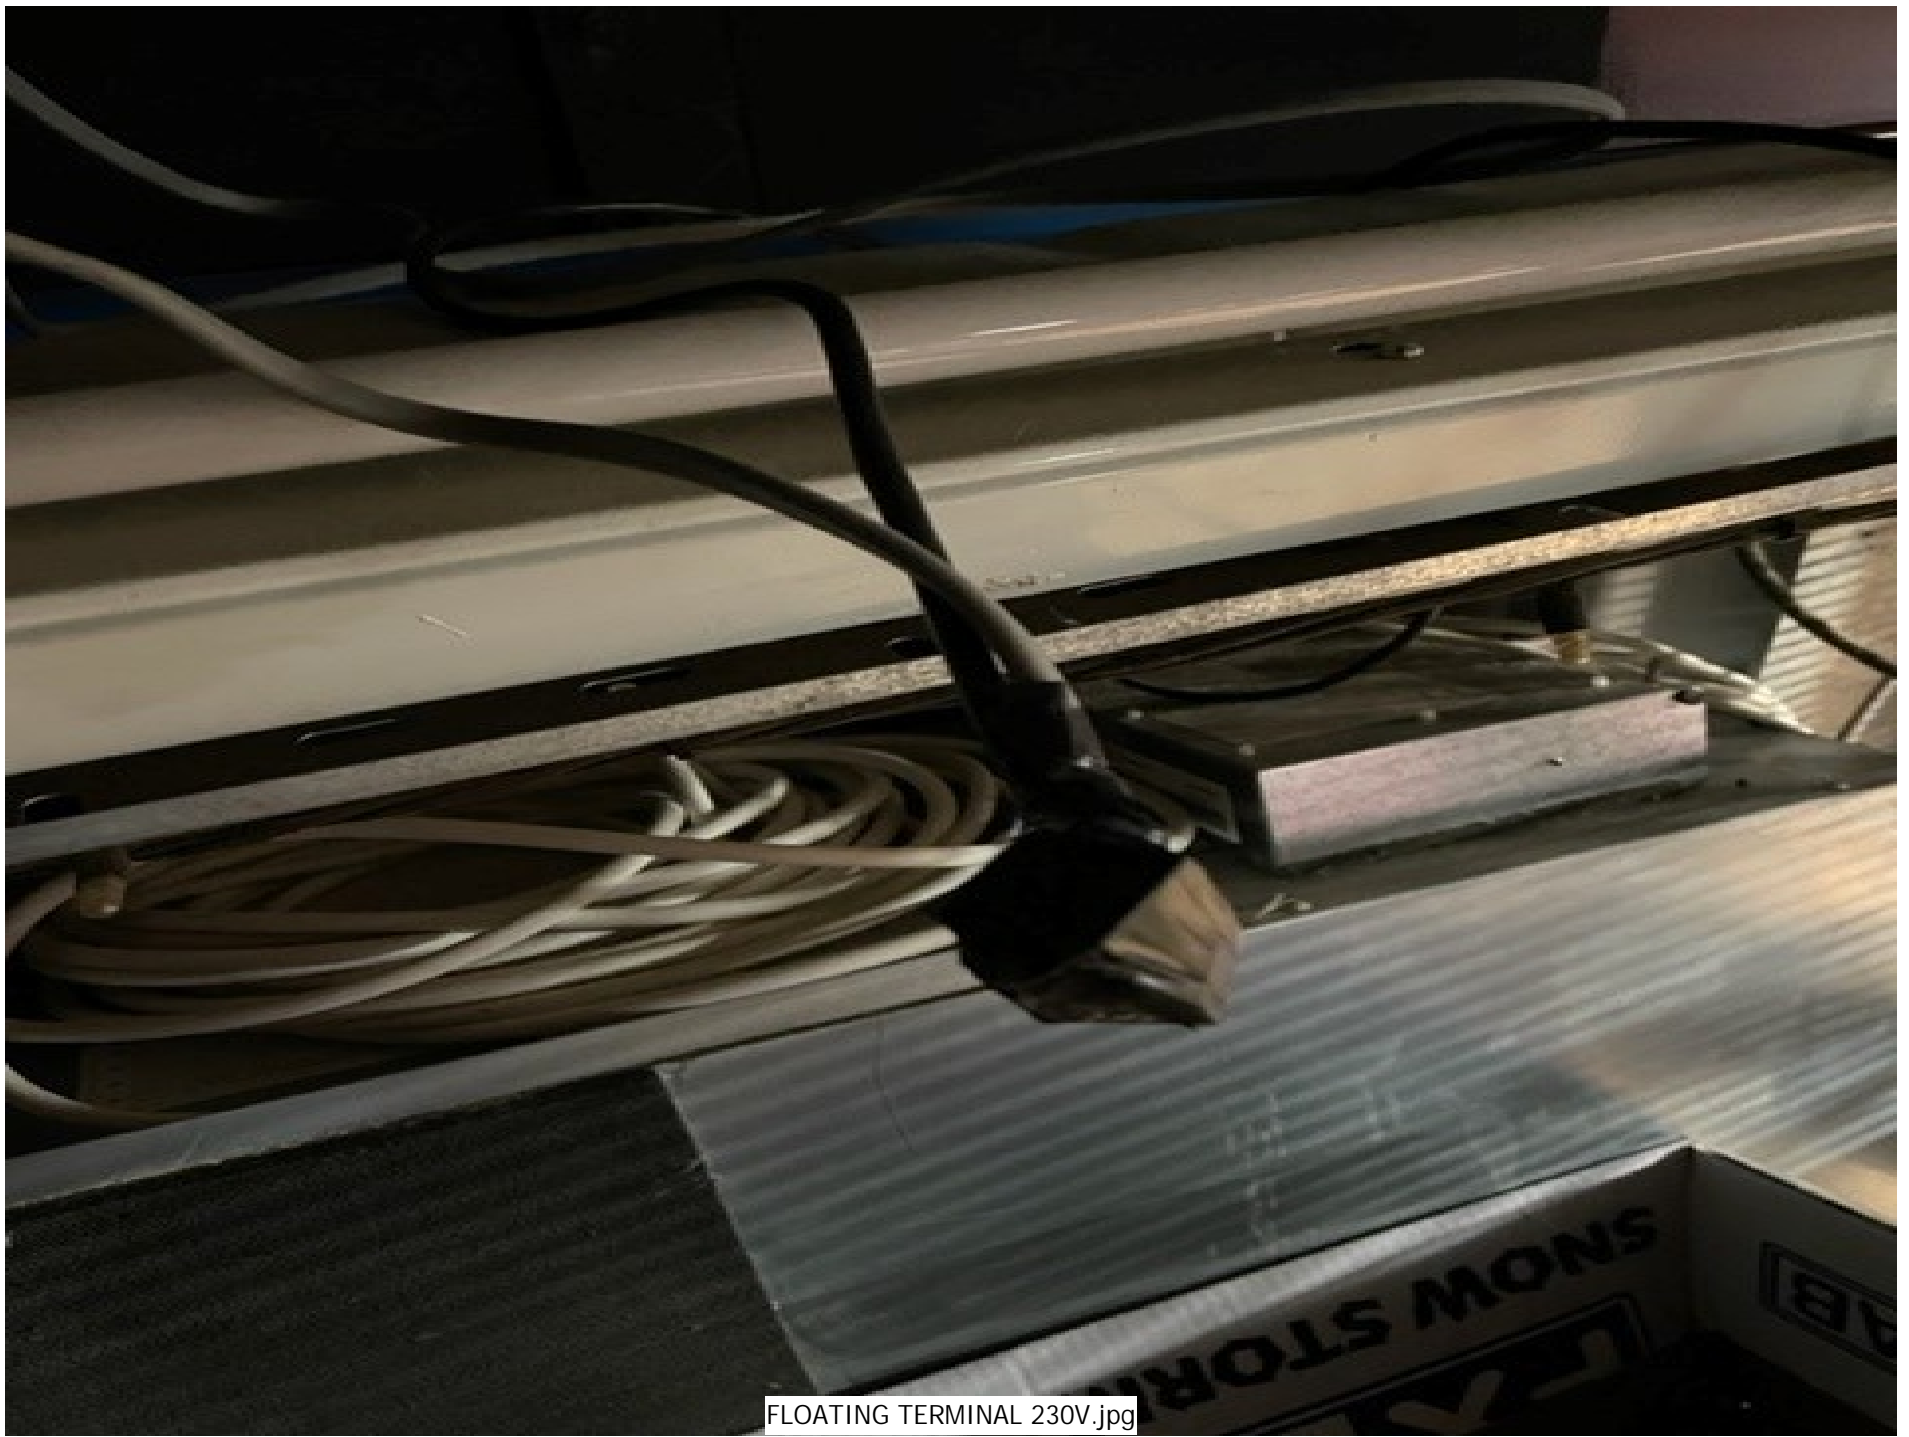


FLOATING TERMINAL 230V.jpg






INNER CORES EXPOSED AT JUNCTION BOX.jpg

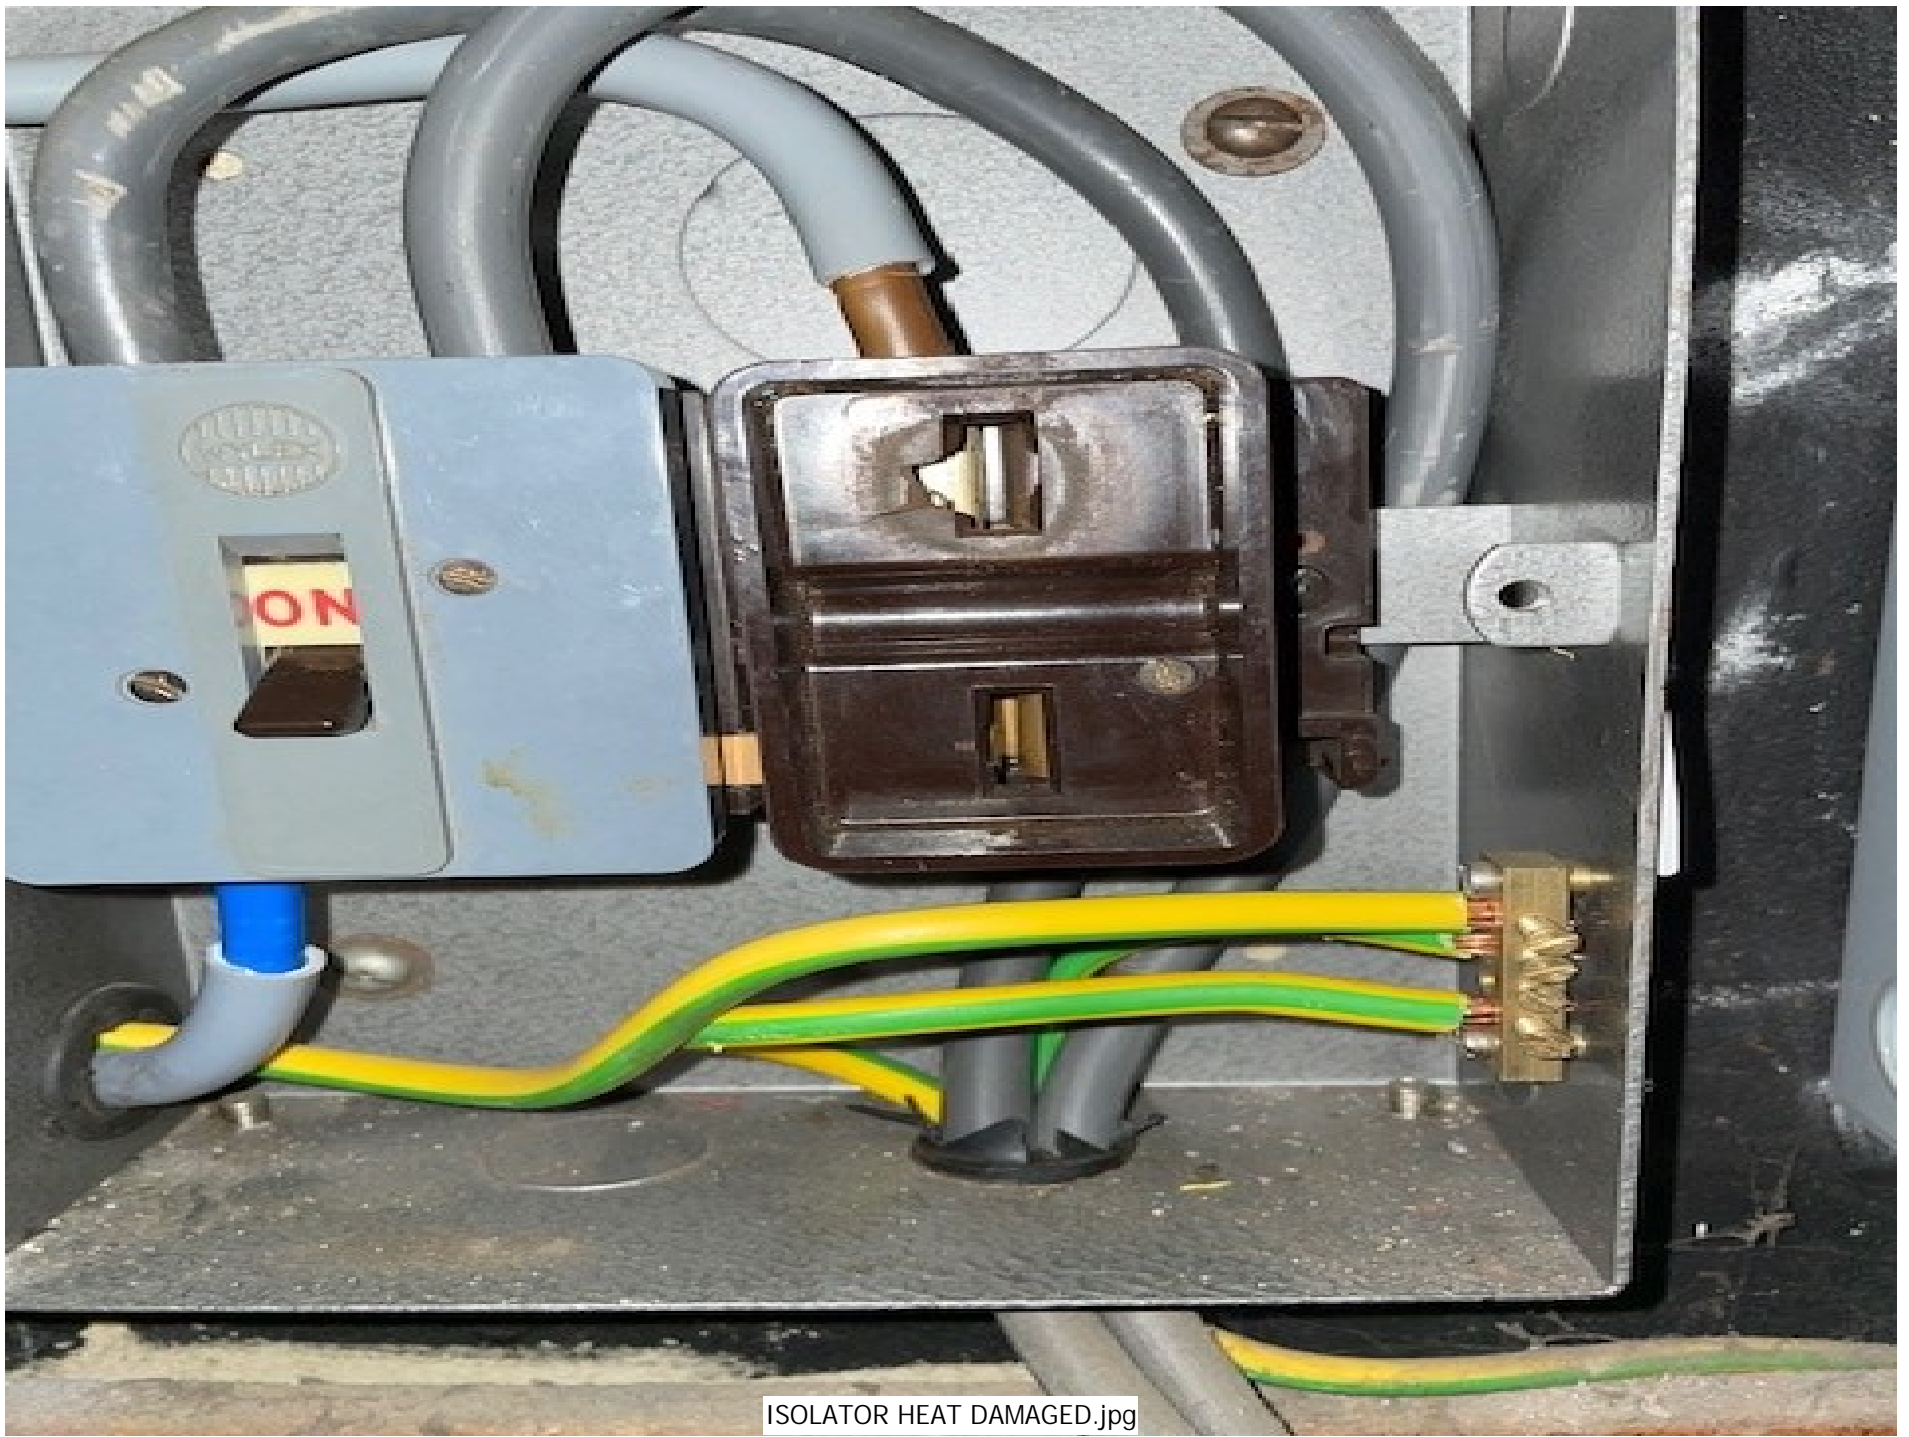


ISOLATOR HEAT DAMAGED.jpg

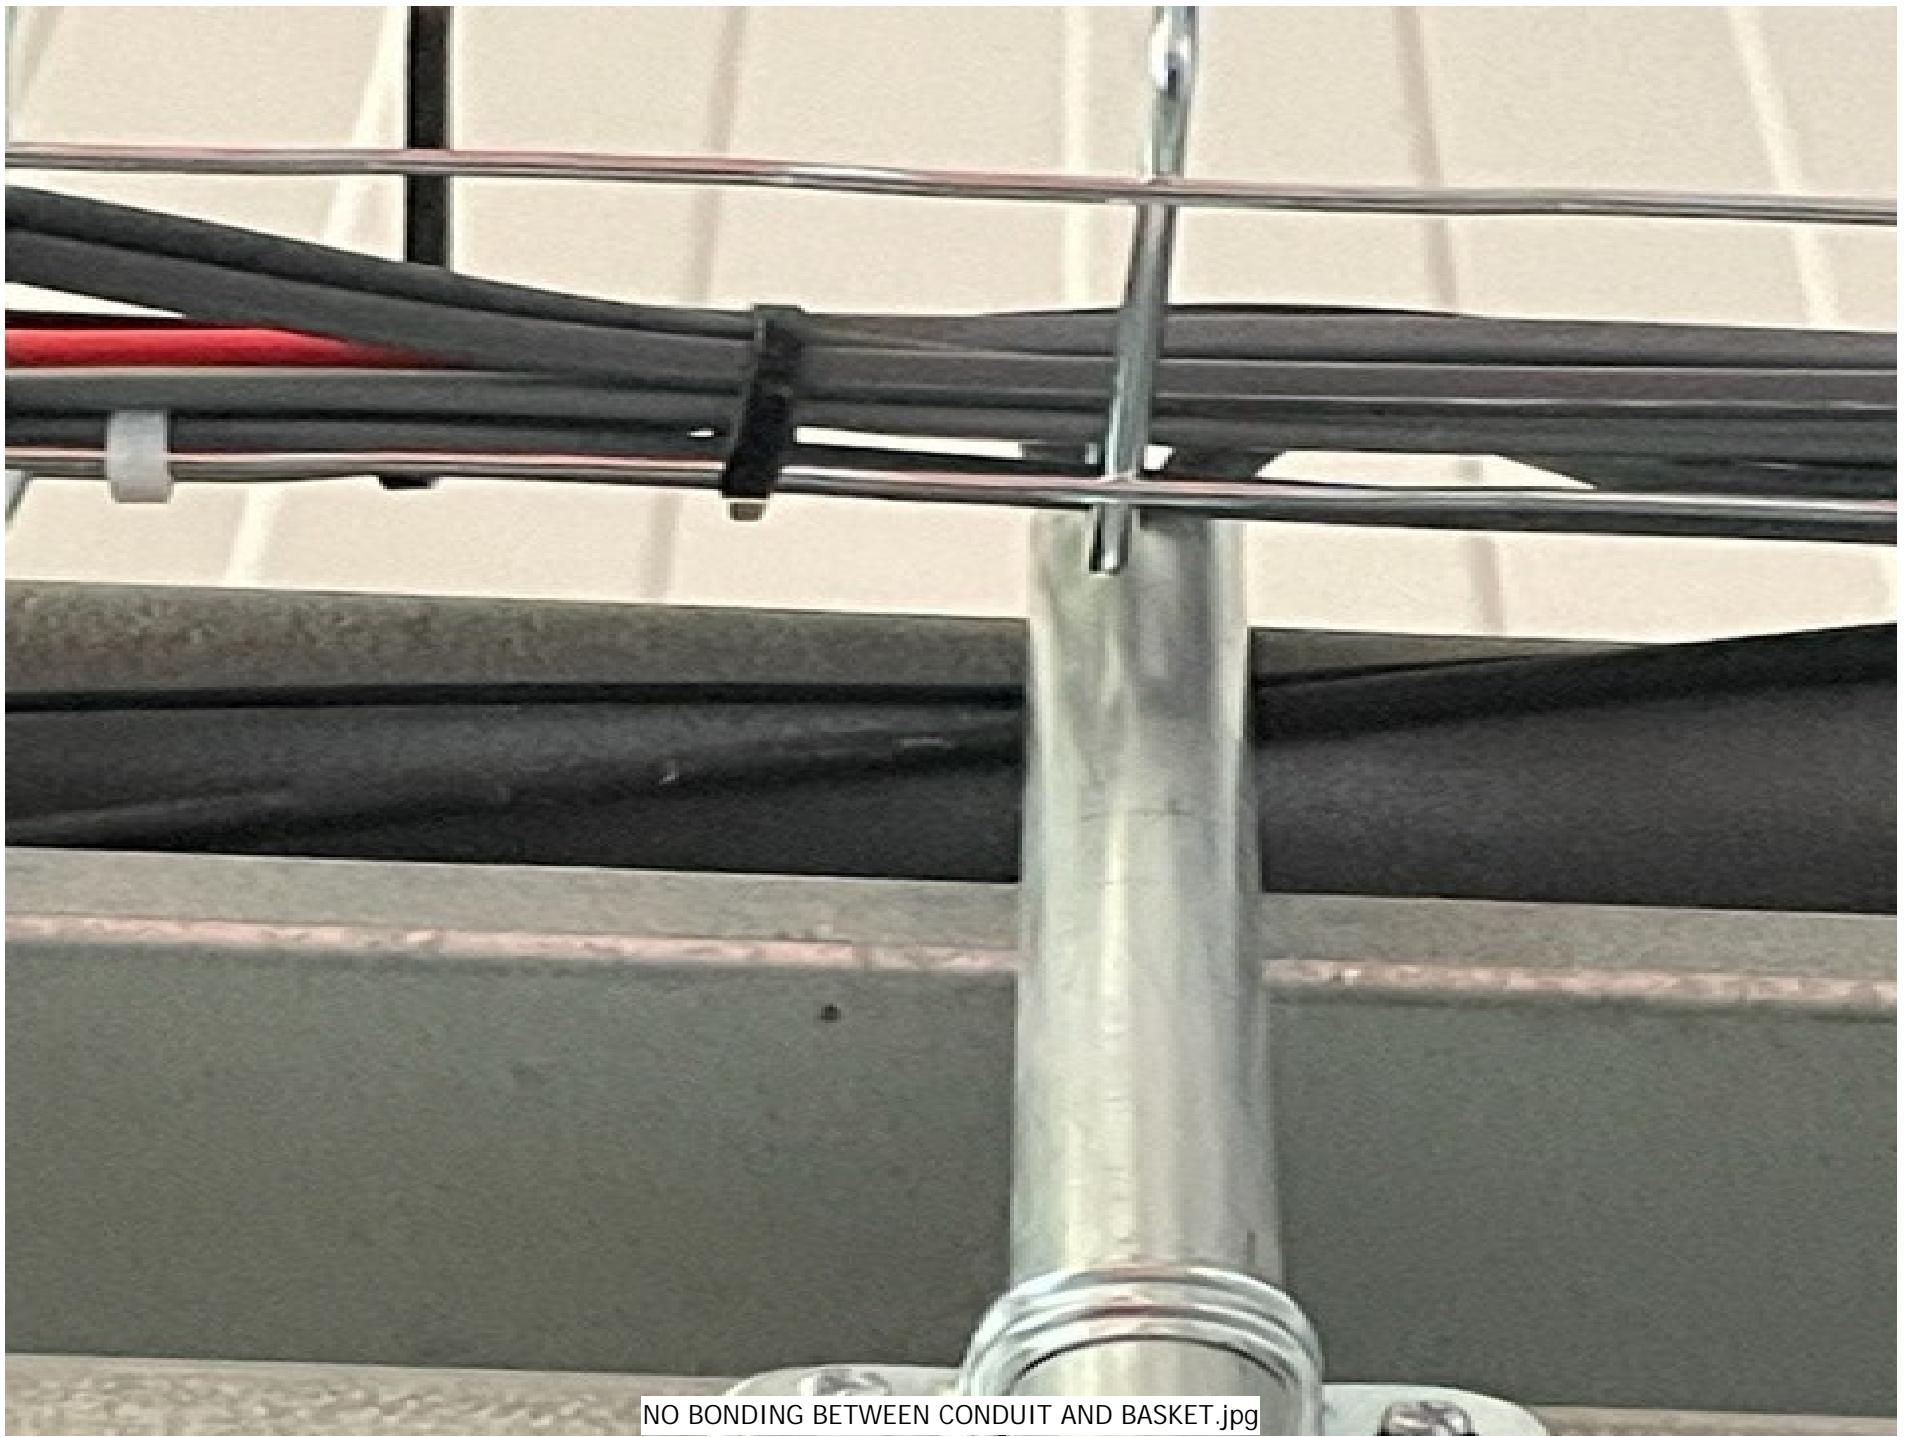

NO BONDING BETWEEN CONDUIT AND BASKET.jpg



NO BONDING TO BACK BOX.jpg

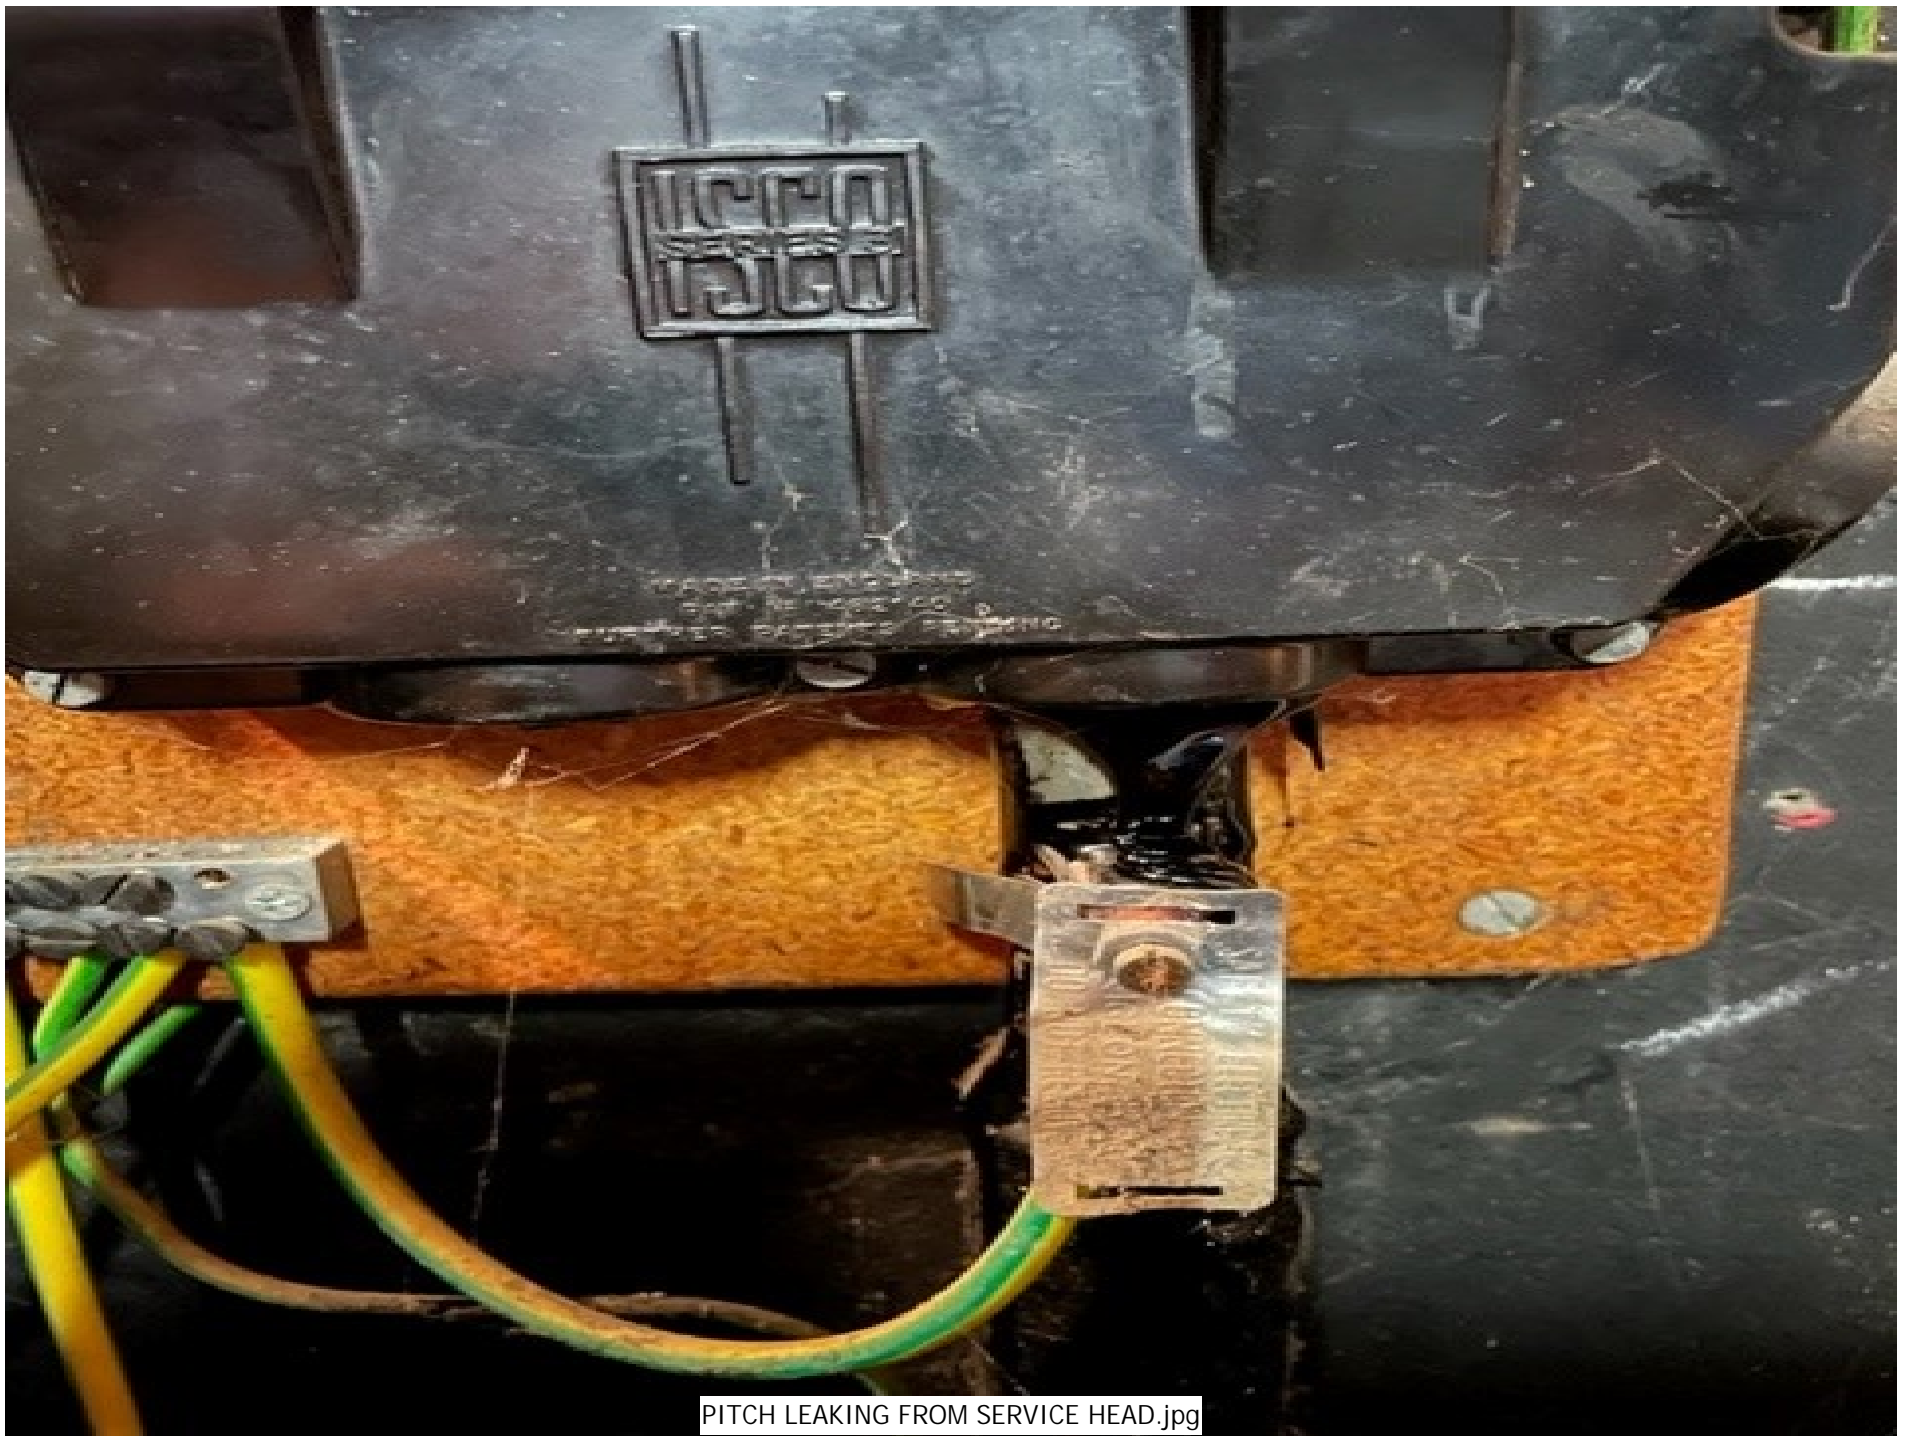

PITCH LEAKING FROM SERVICE HEAD.jpg



POOR INSTALLATION.jpg

## ELECTRICAL INSTALLATION CONDITION REPORT GUIDANCE FOR RECIPIENTS

(to be appended to the Report)

This Report is an important and valuable document which should be retained for future reference.

1. The purpose of this Report is to confirm, so far as reasonably practicable, whether or not the electrical installation is in a satisfactory condition for continued service (see Section 5). The Report should identify any damage, deterioration, defects and/or conditions which may give rise to danger.
2. The person ordering the Report should have received the 'original' Report and the inspector should have retained a duplicate.
3. The 'original' Report should be retained in a safe place and be made available to any person inspecting or undertaking work on the electrical installation in the future. If the property is vacated, this Report will provide the new owner/occupier with details of the condition of the electrical installation at the time the Report was issued.
4. Where the installation incorporates a residual current device (RCD) there should be a notice at or near the device stating that it should be tested six-monthly. For safety reasons it is important that this instruction is followed.
5. Section 4 (Extent and Limitations) should identify fully the extent of the installation covered by this Report and any limitations on the inspection and testing. The inspector should have agreed these aspects with the person ordering the Report and with other interested parties (licensing authority, insurance company, mortgage provider and the like) before the inspection was carried out.
6. Some operational limitations such as inability to gain access to parts of the installation or an item of equipment may have been encountered during the inspection. The inspector should have noted these in Section 4.
7. For items classified in Section 7 as C1 ('Danger present'), the safety of those using the installation is at risk, and it is recommended that a skilled person or persons competent in electrical installation work undertakes the necessary remedial work immediately.
8. For items classified in Section 7 as C2 ('Potentially dangerous'), the safety of those using the installation may be at risk and it is recommended that a skilled person or persons competent in electrical installation work undertakes the necessary remedial work as a matter of urgency.
9. Where it has been stated in Section 7 that an observation requires further investigation (code FI) the inspection has revealed an apparent deficiency which may result in a code C1 or C2, and could not, due to the extent or limitations of the inspection, be fully identified. Such observations should be investigated without delay. A further examination of the installation will be necessary, to determine the nature and extent of the apparent deficiency (see Section 6).
10. For safety reasons, the electrical installation should be re-inspected at appropriate intervals by a skilled person or persons, competent in such work. The recommended date by which the next inspection is due is stated in Section 6 of the Report under 'Recommendations' and on a label at or near to the consumer unit/ distribution board.